

## Coupling high-rate activated sludge process with aerobic granular sludge process for sustainable municipal wastewater treatment

Kosar, Sadiye; Isik, Onur; Cicekalan, Busra; Gulhan, Hazal; Cingoz, Seyma; Yoruk, Mustafa; Ozgun, Hale; van Loosdrecht, Mark C.M.; Ersahin, Mustafa Evren; More Authors

**DOI**

[10.1016/j.jenvman.2022.116549](https://doi.org/10.1016/j.jenvman.2022.116549)

**Publication date**

2023

**Document Version**

Final published version

**Published in**

Journal of Environmental Management

**Citation (APA)**

Kosar, S., Isik, O., Cicekalan, B., Gulhan, H., Cingoz, S., Yoruk, M., Ozgun, H., van Loosdrecht, M. C. M., Ersahin, M. E., & More Authors (2023). Coupling high-rate activated sludge process with aerobic granular sludge process for sustainable municipal wastewater treatment. *Journal of Environmental Management*, 325, Article 116549. <https://doi.org/10.1016/j.jenvman.2022.116549>

**Important note**

To cite this publication, please use the final published version (if applicable).  
Please check the document version above.

**Copyright**

Other than for strictly personal use, it is not permitted to download, forward or distribute the text or part of it, without the consent of the author(s) and/or copyright holder(s), unless the work is under an open content license such as Creative Commons.

**Takedown policy**


Please contact us and provide details if you believe this document breaches copyrights.  
We will remove access to the work immediately and investigate your claim.

***Green Open Access added to TU Delft Institutional Repository***

***'You share, we take care!' - Taverne project***

**<https://www.openaccess.nl/en/you-share-we-take-care>**

Otherwise as indicated in the copyright section: the publisher is the copyright holder of this work and the author uses the Dutch legislation to make this work public.



## Research article

# Coupling high-rate activated sludge process with aerobic granular sludge process for sustainable municipal wastewater treatment

Sadiye Kosar<sup>a,\*</sup>, Onur Isik<sup>a,b,c</sup>, Busra Cicekalan<sup>a</sup>, Hazal Gulhan<sup>a</sup>, Seyma Cingoz<sup>d</sup>, Mustafa Yoruk<sup>d</sup>, Hale Ozgun<sup>a,b</sup>, Ismail Koyuncu<sup>a,b</sup>, Mark C.M. van Loosdrecht<sup>e</sup>, Mustafa Evren Ersahin<sup>a,b</sup>

<sup>a</sup> Istanbul Technical University, Civil Engineering Faculty, Environmental Engineering Department, Ayazaga Campus, Maslak, 34469, Istanbul, Turkey

<sup>b</sup> National Research Center on Membrane Technologies, Istanbul Technical University, 34469, Maslak, Istanbul, Turkey

<sup>c</sup> Kahramanmaraş Sutcu Imam University, Engineering and Architecture Faculty, Environmental Engineering Department, Onikisubat, 46100, Kahramanmaraş, Turkey

<sup>d</sup> ISKI, Istanbul Water and Sewerage Administration, Eyup, 34060, Istanbul, Turkey

<sup>e</sup> Delft University of Technology, Department of Biotechnology, van der Maasweg 9, 2629, HZ, Delft, the Netherlands



## ARTICLE INFO

## Keywords:

Aerobic granular sludge  
Energy recovery  
High-rate activated sludge  
Municipal wastewater  
Sustainability

## ABSTRACT

Achieving a neutral/positive energy balance without compromising discharge standards is one of the main goals of wastewater treatment plants (WWTPs) in terms of sustainability. Aerobic granular sludge (AGS) technology promises high treatment performance with low energy and footprint requirement. In this study, high-rate activated sludge (HRAS) process was coupled to AGS process as an energy-efficient pre-treatment option in order to increase energy recovery from municipal wastewater and decrease the particulate matter load of AGS process. Three different feeding strategies were applied throughout the study. AGS system was fed with raw municipal wastewater, with the effluent of HRAS process, and with the mixture of the effluent of HRAS process and raw municipal wastewater at Stage 1, Stage 2 and Stage 3, respectively. Total suspended solids (TSS), chemical oxygen demand (COD), ammonia nitrogen ( $\text{NH}_4\text{-N}$ ), and total phosphorus (TP) concentrations in the effluent were less than 10 mg/L, 60 mg/L, 0.4 mg/L, and 1.3 mg/L respectively at all stages. Fluctuations were observed in the denitrification performance due to changes in the influent COD/total nitrogen (TN) ratio. This study showed that coupling HRAS process with AGS process by feeding the AGS process with the mixture of HRAS process effluent and raw municipal wastewater could be an appropriate option for both increasing the energy recovery potential of WWTPs and enabling high effluent quality.

## 1. Introduction

Upgrading wastewater treatment plants (WWTPs) and/or applying novel wastewater treatment technologies has been essential to meet stringent discharge standards (Wang et al., 2012). Land and energy requirements together with excess sludge handling cost are the key factors that need to be considered solidly to obtain a feasible treatment in WWTPs in terms of technical and economic aspects (Chen et al., 2020; Zaborowska et al., 2021). Nowadays, efficient use of resources has become vital and thus, efforts on sustainability have been put into practice for WWTPs. Since energy is a crucial element of sustainability, achieving a neutral/positive energy balance in WWTPs without compromising discharge standards becomes to be one of the main targets (Maktabifard et al., 2020). There are two ways for achieving

sustainability in WWTPs in terms of energy: Decreasing energy demand in WWTPs and maximizing energy harvest from the wastewater (Maktabifard et al., 2018; Yan et al., 2020).

Biological nutrient removal (BNR) plants generally consist of suspended growth bioreactors having different redox zones, and discrete secondary clarifier tanks, where solids are separated and recirculated to the bioreactors. Various modifications have been developed for the BNR processes in order to increase the nutrient removal efficiency. Various activated sludge (AS) process configurations such as  $\text{A}^2/\text{O}$ , modified (five-stage) Bardenpho, and modified UCT have been applied for biological wastewater treatment technology to remove carbonaceous matter and nutrients (nitrogen, phosphorus) over the century (Jenkins and Wanner, 2014). However, large footprint and energy requirement of nutrient removing AS processes accelerated the research for new

\* Corresponding author.

E-mail address: [sadiye.kosar@outlook.com](mailto:sadiye.kosar@outlook.com) (S. Kosar).

technologies (Ferreira et al., 2021).

Aerobic granular sludge (AGS) process offers up to 75% decrease in footprint requirement and 30–50% less energy consumption compared to A<sup>2</sup>/O process (Pronk et al., 2015; Thwaites et al., 2018). In the AGS process, aerobic granules are responsible for the biological removal in contrast to flocs in the AS processes. There are different redox layers inside the granules that create optimum conditions for the removal of carbon and nutrient in a single reactor (de Kreuk et al., 2007; Adav et al., 2008). The inner anoxic/anaerobic zone is occupied by denitrifiers and facultative phosphate accumulating organisms (PAOs) (Winkler et al., 2015), while the surface aerobic zone is dominated by aerobic heterotrophs and autotrophs, mainly nitrifiers (Liu, 2006; Winkler et al., 2015). Therefore, simultaneous carbon, nitrogen, and phosphorus removal can be achieved in a single granule (de Kreuk et al., 2005).

Presently, there are more than 80 full-scale AGS treatment plants operated in the world, and it is seen as one of the key technologies of wastewater treatment for next century (van Loosdrecht and Brdjanovic, 2014; van Haandel and van der LubbeDesign, 2015; Ferreira et al., 2021; Hamza et al., 2022). In full-scale AGS applications for municipal wastewater treatment, effluent chemical oxygen demand (COD), total nitrogen (TN), and total phosphorus (TP) concentrations have been reported between 64 and 90 mg/L, 6.9–10 mg/L, and 0.9–3.2 mg/L respectively (Li et al., 2014; Pronk et al., 2015). Although AGS process promises high treatment performance, transforming the activated sludge flocs into granules takes long time (Kosar et al., 2022; van Dijk et al., 2022). AGS process can be combined as a pre-treatment or post-treatment alternative to different wastewater treatment configurations to either decrease the granulation time or increase the treatment performance (Giesen and Thompson, 2013; Pronk et al., 2017). Another important issue regarding AGS systems is the excess granular sludge. The excess sludge from AGS process can be used as inoculum to accelerate aerobic granulation in other reactors, which are in start-up period (Li et al., 2015a; Long et al., 2014). In the scope of the circular economy concept, phosphorus, biopolymers (Kaumera) (including alginate-like exopolysaccharides (ALE)), and polyhydroxyalkanoates (PHA) in AGS sludge can be extracted and evaluated for beneficial use (Ferreira et al., 2021). The other important value of the excess sludge is its energy content. Energy can be recovered by conversion of organic content of excess biological sludge to methane via anaerobic digestion. However, excess biological sludge has less energy content compared to primary sludge. Because most of the organic content in wastewater is used by biomass in the bioreactors and converted to CO<sub>2</sub>, thus, less organic content is available in the excess sludge. Carbon capture processes are gaining popularity to maximize energy recovery from wastewater (Rahman et al., 2020). In carbon capture processes, carbon in the wastewater is redirected to anaerobic digesters through the waste sludge without losing it to the atmosphere in CO<sub>2</sub> form. The integration of carbon capture processes with the AGS process can be attractive for maintaining energy balance and sustainability in AGS plants.

High-rate activated sludge (HRAS) process as a carbon capture process is used as the first stage of two-step AS system, represented as adsorption bio-oxidation (AB) process (Bohnke, 1983). HRAS process has been getting attention due to an increasing tendency to the concept of carbon capture from wastewater in recent years. Carbon loss via mineralization is reduced with low sludge retention time and low dissolved oxygen (DO) concentration in HRAS process, and concentrated carbon in the excess sludge can be anaerobically digested for energy production. Lack of nitrification in the HRAS process results in high concentrations TN in the effluent (Guven et al., 2019). For this reason, HRAS system, represented as high loaded biological adsorption stage (A Stage), is applied as the first step of AB process, while nutrient is removed by the second step, referred as low loaded bio-oxidation stage (B stage) (de Graaff et al., 2016; Wan et al., 2016). Around 60% of the influent COD could be removed by HRAS process and the effluent has a low COD/TN ratio, so it is usually integrated with low COD needed treatment processes, e.g. shortcut biological nitrogen removal process

(SBNR) and partial nitrification with anammox process (Wan et al., 2016; Guven et al., 2017; Rahman et al., 2019).

This study aims to combine the energy recovery potential of HRAS process with the high treatment performance of AGS process by feeding HRAS process effluent to AGS system. In this scope, AGS process was fed with raw municipal wastewater; effluent of an HRAS process; and mixture of the effluent of HRAS process and raw municipal wastewater, in order. Sludge characteristics and treatment performance were studied comprehensively in the AGS process. Coupling of both processes can improve the potential for energy recovery from wastewater while obtaining good effluent quality, thus sustainable wastewater treatment can be achieved. For this purpose, the effect of coupling of the two processes on the treatment performance was studied, and an appropriate treatment configuration was proposed.

## 2. Material and methods

### 2.1. Experimental set-up

A laboratory-scale AGS reactor (plexiglass, 180 cm of height, 10 cm of diameter) with a specially made rubber diffuser, and online sensors (pH (Kuntze Instrument, Germany), temperature (Meter, Turkey), DO (Aqualabo, France), oxidation reduction potential (ORP) (Kuntze Instrument, Germany), and level sensor (IFM, Germany) was used in the study (Fig. 1). Wastewater in the influent tank was fed from the bottom point of the reactor via feed pump (Seepex, Germany), while treated wastewater was transferred to the effluent tank via discharge pump (Lead Fluid, China). The influent flowrate was monitored via a flowmeter (IFM, Germany). During anaerobic phase, recirculation from the top of the reactor to the bottom was performed via recirculation pump (Lead Fluid, China).

### 2.2. Seed sludge and wastewater characterization

The laboratory-scale AGS system was seeded with waste activated sludge (WAS) taken from a full-scale municipal wastewater treatment plant operated as a BNR system. Characterization of the seed sludge is given in Table 1. The AGS system was fed at three stages with different influents including (i) raw municipal wastewater (Stage 1), (ii) effluent of HRAS process treating the same raw municipal wastewater (Stage 2), (iii) mixture of raw municipal wastewater (20% of the mixture) and effluent of HRAS process (80% of the mixture) (Stage 3). Characterization of the influent for each stage is given in Table 2. Raw wastewater (Stage 1) had the highest COD/TN ratio, whereas the effluent of HRAS process (Stage 2) had the lowest COD/TN ratio.

### 2.3. Experimental procedure

The study consisted of three stages based on influent type. The AGS reactor was operated on simultaneously fill/draw sequencing batch reactor (SBR) mode. Six cycles per day were applied in SBR mode. Duration of each cycle was 240 min including fill/draw phase (30 min), anaerobic phase (50 min), aerobic phase (128 min), settling phase (30 min), and idle phase (2 min). Height to diameter (H/D) ratio of the AGS reactor was 15 (water level was 150 cm in the reactor) and volume exchange ratio (VER) was provided as 50%. The AGS system was inside an air-conditioned laboratory, so the temperature was almost stable during the operation period. pH arrangement was not needed during operation. Due to the change in the influent characterization among three stages, OLR has also changed at each stage. OLR was  $1.24 \pm 0.03$  kg COD/m<sup>3</sup>. day,  $0.46 \pm 0.03$  kg COD/m<sup>3</sup>. day, and  $0.77 \pm 0.03$  kg COD/m<sup>3</sup>. day at Stage 1, Stage 2 and Stage 3, in order.

### 2.4. Analytical methods

TSS, VSS, COD, TN, NH<sub>4</sub><sup>+</sup>-N, and TP measurements were conducted

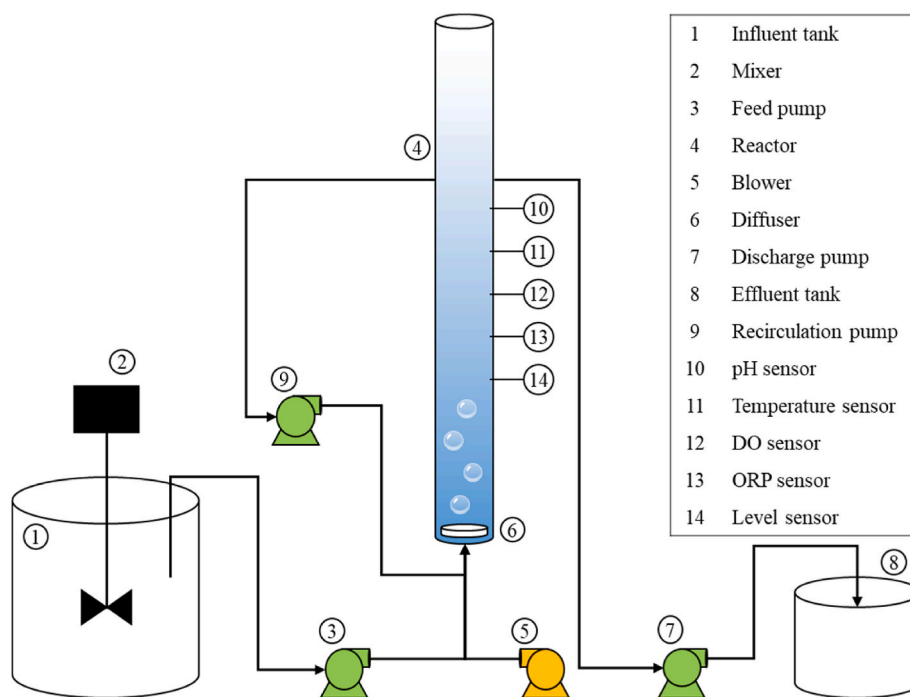


Fig. 1. Experimental set-up of lab-scale AGS system.

**Table 1**  
Characterization of the seed sludge.

Parameter	Unit	Value (Average $\pm$ Standard Deviation (SD))
COD	mg/L	15,462 $\pm$ 340
Soluble COD (sCOD)	mg/L	169 $\pm$ 16
sCOD/COD	%	1.1 $\pm$ 0.04
Total Suspended Solids (TSS)	mg/L	11,460 $\pm$ 220
Volatile Suspended Solids (VSS)	mg/L	8110 $\pm$ 230
Sludge Volume Index <sub>5</sub> (SVI <sub>5</sub> )	mL/g	154 $\pm$ 5
SVI <sub>30</sub>	mL/g	78 $\pm$ 1.0
Normalized Capillary Suction Time (CST)	sec/g	1.44 $\pm$ 0.09
pH	–	7.30 $\pm$ 0.02
Median Particle Size (d <sub>50</sub> )	$\mu$ m	49 $\pm$ 0.4

according to Standard Methods (APHA, 2017). Samples were filtered through 0.45  $\mu$ m filters prior to soluble COD (sCOD) measurement. Turbidity and particle size distribution (PSD) measurements in the influent and effluent samples were conducted by a turbidimeter (Hach 2100 P, USA) and a PSD analyzer (Zetasizer Nano-S, Malvern Instrument, UK), respectively. Ion chromatography system (Dionex ICS – 300) was used for nitrate (NO<sub>3</sub><sup>-</sup>) measurements. PSD of the sludge was measured by using Mastersizer 2000 (Malvern Instruments, Hydro 2000 MU, UK). SVI<sub>30</sub> of the sludge was determined according to Standard Methods (APHA, 2017). The volumes of 1 g of sludge after 5 min and 10 min of settling time were measured as SVI<sub>5</sub> and SVI<sub>10</sub>, respectively. Batch settling tests were applied to measure hindered settling velocities of the sludge samples (van Loosdrecht et al., 2016). CST of the sludge samples was measured with 18 mm funnel by a CST analyzer (Triton Electronics, Type 304 M, UK).

Environmental scanning electron microscopy (ESEM) (Thermo Fisher Scientific, FEI Quanta FEG 250, USA) was used to observe surface morphology of the dried granules. To increase the conductivity of the

**Table 2**  
Characterization of the influent to the AGS reactor.

Parameter	Unit	Value (Average $\pm$ SD)		
		Stage 1	Stage 2	Stage 3
COD	mg/L	414 $\pm$ 12	153 $\pm$ 11	257 $\pm$ 11
sCOD	mg/L	209 $\pm$ 9	100 $\pm$ 10	139 $\pm$ 7
TSS	mg/L	307 $\pm$ 12	46 $\pm$ 6	61 $\pm$ 3
TN	mg/L	51 $\pm$ 2	43 $\pm$ 4	44 $\pm$ 4
Ammonium Nitrogen (NH <sub>4</sub> <sup>+</sup> -N)	mg/L	35 $\pm$ 1	34 $\pm$ 4	35 $\pm$ 2
TP	mg/L	6.0 $\pm$ 0.4	2.6 $\pm$ 0.2	3.2 $\pm$ 0.1
Turbidity	NTU	217 $\pm$ 7	37 $\pm$ 2	59 $\pm$ 4
pH	–	7.47 $\pm$ 0.04	7.51 $\pm$ 0.08	7.51 $\pm$ 0.02
COD/TN	–	8.2 $\pm$ 0.5	3.6 $\pm$ 0.3	5.9 $\pm$ 0.6

samples, palladium (Pd) and gold (Au) were used in coating the samples with a vacuum evaporator (Quorum SC7620, UK) prior to ESEM analysis. Organics on the surface of the dried granules were determined by using Fourier transform infrared spectroscopy (FTIR) (PerkinElmer, Spectrum 100, USA). The method including high temperature-sodium carbonate (Na<sub>2</sub>CO<sub>3</sub>) extraction, that was described by Felz et al. (2016), was used for the extraction of extracellular polymeric substances (EPS). Extracellular proteins (pEPS) and extracellular carbohydrates (cEPS) were determined using bovine serum albumin and d-glucose monohydrate as standards, respectively. Modified Lowry method was used for protein measurements (Frolund et al., 1995). For carbohydrate measurements, the method described in Dubois et al. (1956) was used.

Effluent quality at each stage was compared using effluent quality index (EQI) Equation (1) (Copp, 2002). EQI was calculated using the

average concentrations of TSS, COD, nitrate and nitrite (NO), Total Kjeldahl nitrogen (TKN), and TP in the effluent. The weighting factors for different parameters were used as  $\beta_{TSS} = 2$ ,  $\beta_{COD} = 1$ ,  $\beta_{NO} = 1$ ,  $\beta_{TKN} = 20$ , and  $\beta_{TP} = 20$ .  $\beta_{TSS}$ ,  $\beta_{COD}$ ,  $\beta_{NO}$ , and  $\beta_{TKN}$  were selected as suggested by Copp (2002). Weighting factor for TP parameter was selected same as the one used for TKN parameter (Gernaey and Jorgensen, 2004).

$$EQI = (\beta_{TSS} \times TSS_{\text{effluent}}) + (\beta_{COD} \times COD_{\text{effluent}}) + (\beta_{NO} \times NO_{\text{effluent}}) + (\beta_{TKN} \times TKN_{\text{effluent}}) + (\beta_{TP} \times TP_{\text{effluent}}) \quad (1)$$

### 3. Results and discussion

#### 3.1. Treatment performance

After seeding the system with flocculent sludge and feeding it with raw wastewater, the AGS process reached steady-state conditions on the 61st day, then, TSS concentration in the reactor and the pollutant concentrations in the effluent became stable. Then the AGS reactor was fed with raw wastewater in stage 1, the effluent of HRAS process, and a mixture of the effluent of HRAS process and raw wastewater in stage 3. Average effluent TSS concentration was lower than 10 mg/L at each stage. The highest TSS removal efficiency was obtained as  $97 \pm 0.4\%$  at Stage 1. At Stage 2 and Stage 3, average TSS removal efficiencies were  $85 \pm 3\%$  and  $87 \pm 2\%$ , respectively. The highest COD removal efficiency was also achieved at Stage 1 (COD removal efficiencies:  $86 \pm 1.1\%$  (Stage 1),  $71 \pm 2.7\%$  (Stage 2),  $84 \pm 1.9\%$  (Stage 3)). Average concentrations of COD, TP, TN, and  $NH_4^+-N$  parameters in the effluent were  $58.5 \pm 3.6$  mg/L,  $1.28 \pm 0.17$  mg/L,  $12.5 \pm 1.4$  mg/L, and  $0.35 \pm 0.16$  mg/L, respectively at Stage 1 (Fig. 2). At Stage 2, in which the effluent of HRAS process was fed to the AGS system, COD, TP, and  $NH_4^+-N$  concentrations in the effluent were decreased to  $43.3 \pm 2.1$  mg/L,  $1.08 \pm 0.08$  mg/L, and  $0.29 \pm 0.09$  mg/L, respectively. However, higher

concentration of TN ( $17.9 \pm 0.9$  mg/L in average) was observed in the effluent at Stage 2. Lower COD/TN ratio in the influent at Stage 2 ( $3.6 \pm 0.3$ ) compared to Stage 1 ( $8.2 \pm 0.5$ ) hampered denitrification, and thus decreased the nitrogen removal efficiency of AGS process. Limited denitrification capacity resulted in an increase in the effluent nitrate nitrogen ( $NO_3^-N$ ) concentration at Stage 2 in comparison to Stage 1, from  $8.8 \pm 0.6$  mg  $NO_3^-N/L$  to  $11.4 \pm 0.7$  mg  $NO_3^-N/L$ . At Stage 3, effluent of a pilot-scale HRAS process was mixed with raw municipal wastewater to increase the COD/TN ratio of the influent from  $3.6 \pm 0.3$  to  $5.9 \pm 0.6$ . As a result, average TN and  $NO_3^-N$  concentrations in the effluent decreased to  $10.8 \pm 1.8$  mg/L and  $7.4 \pm 0.6$  mg/L, respectively. Average COD, TP, and  $NH_4^+-N$  concentrations in the effluent were  $39.8 \pm 4.2$  mg/L,  $1.14 \pm 0.18$  mg/L, and  $0.25 \pm 0.14$  mg/L, respectively at Stage 3 (Fig. 2). Effluent COD and TP concentrations were consistent with the data reported for full-scale AGS processes in the literature (COD: 40–90 mg/L, TP: 0.9–3.2 mg/L) (Giesen and Thompson, 2013; Pronk et al., 2015). At Stage 1 and Stage 2 similar average  $d_{50}$  values ( $415 \pm 21$  nm and  $443 \pm 59$  nm, respectively) in the effluent were obtained. On the other hand, average  $d_{50}$  value in the effluent decreased to  $263 \pm 10$  nm at Stage 3 (Fig. 3).

#### 3.2. Sludge characteristics

TSS concentration in AGS reactor at the first day of operation was 6735 mg/L, it decreased to 4521 mg/L at Day 19 because of sludge washout from the system. After Day 20, TSS concentration started to increase, and once the system reached to steady state condition at Day 61, stable TSS concentrations (in the range of 5295–6484 mg/L) were measured in the AGS process. VSS/TSS ratio changed in the range of 77–84% during the whole study.

The values of different parameters representing sludge characteristics are given in Fig. 5  $D_{50}$  values of the sludge at Stage 1 ( $82 \pm 2$   $\mu$ m)

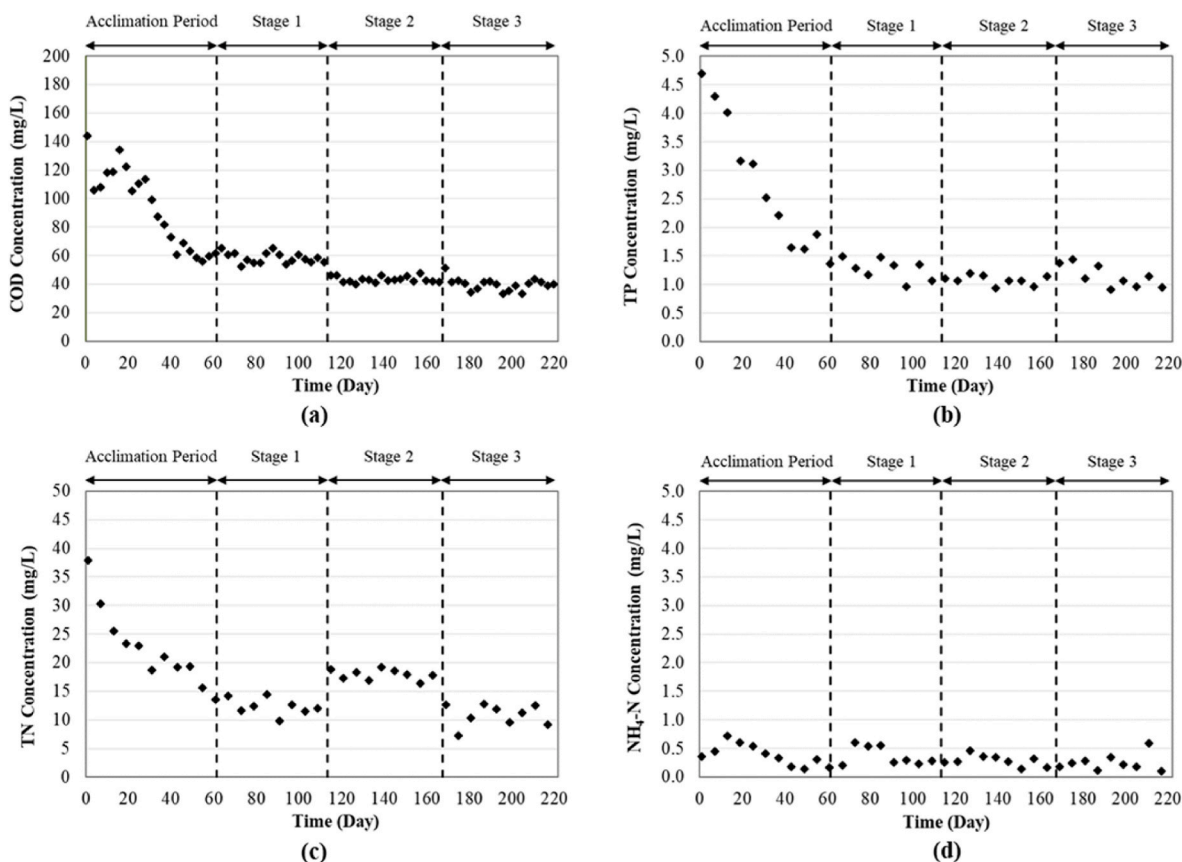


Fig. 2. The concentrations of different parameters in the effluent of AGS system: (a) COD, (b) TP, (c) TN, (d)  $NH_4^+-N$ .



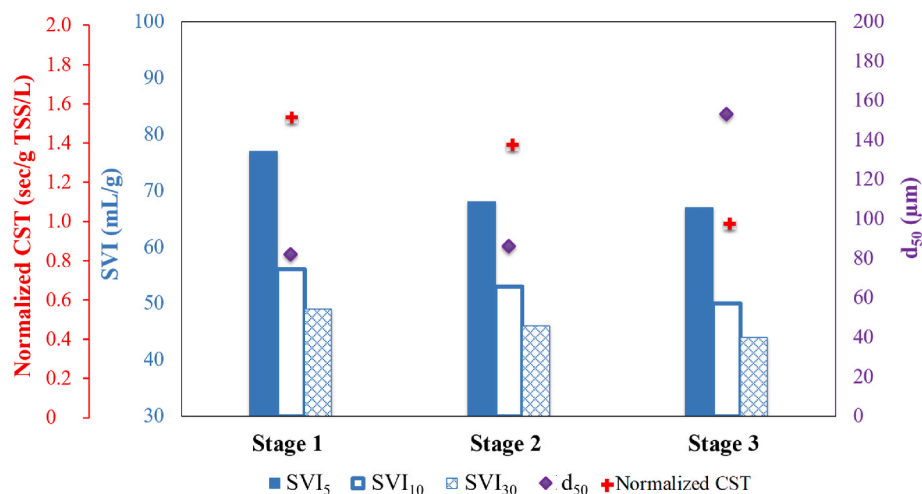


Fig. 3. SVI,  $d_{50}$ , and normalized CST values of the sludge in AGS process.

and Stage 2 ( $87 \pm 3 \mu\text{m}$ ) were similar, whereas higher  $d_{50}$  value ( $153 \pm 11 \mu\text{m}$ ) was obtained at Stage 3. Aerobic granules are formed when microorganisms come together and make a cluster on top of each other. The size of the granules is a significant parameter for the indication of nitrogen removal efficiency (Bathe et al., 2005). Small granules allow oxygen to reach inner layers, while big granules can contain anoxic/anaerobic zones to complete denitrification (Nguyen Quoc et al., 2021). In this study, the effluent nitrate concentration increased from  $8.8 \pm 0.6 \text{ mg/L}$  at Stage 1– $11.4 \pm 0.7 \text{ mg/L}$  at Stage 2, since the lowest influent COD/TN ratio was at Stage 2 ( $3.6 \pm 0.3$ ). The effluent nitrate concentration decreased to  $7.4 \pm 0.6 \text{ mg/L}$  at Stage 3. Increase in COD/TN ratio of the influent from 3.6 (Stage 2) to 5.9 (Stage 3) resulted in an increase in granule size as well as denitrification capacity. Without sufficient available carbon in the influent, the ratio of nitrifiers to heterotrophs may increase, moreover, denitrifiers were dominated by ordinary aerobic heterotrophs. Thus, the absence of sufficient anoxic/anaerobic volume in the core of granules might restrict the enlargement of granules. This might be the reason for obtaining smaller sized granules at Stage 2 compared to Stage 3.

At Stage 2 and Stage 3, similar SVI<sub>30</sub> values were observed, while at Stage 1 SVI<sub>30</sub> values were slightly higher. At all stages, SVI<sub>30</sub> values were compatible with the values (30–67 mL/g) reported in the literature for AGS process treating municipal wastewater (Bengtsson et al., 2018). Similar SVI<sub>30</sub>/SVI<sub>10</sub> ratios were obtained at Stage 1, Stage 2, and Stage 3 ( $0.86 \pm 0.01$ ,  $0.86 \pm 0.02$ , and  $0.89 \pm 0.09$ , respectively). Compared to the SVI<sub>30</sub>/SVI<sub>10</sub> ratio of seed sludge ( $0.51 \pm 0.02$ ), it can be interpreted that granulation was achieved at all stages. The best normalized CST value ( $0.99 \pm 0.05 \text{ s/g TSS/L}$ ) was achieved at Stage 3. Zhang et al. (2020) reported a normalized CST value of  $0.88 \pm 0.01 \text{ s/g TSS/L}$  for an AGS process treating domestic wastewater, which is compatible with the findings in our study.

Another test, that can be used to evaluate the settleability of the sludge, is hindered settling velocity measured by batch settling test. The fastest settling velocity was achieved at Stage 3 (6.3 m/h), while at Stage 1 (1.05 m/h), the granular sludge has the slowest settling characteristics. The settling velocity was measured at Stage 2 as 4.2 m/h. This finding was also consistent with the SVI values obtained at each stage.

ESEM images of the granule surfaces at each stage are given in Fig. 4. Porous structures were observed on the surface of the granules at each stage. Granules observed at Stage 1 and Stage 3 had more amorphous structures compared to Stage 2. At Stage 2, AGS process was fed solely with the effluent of HRAS process, which had almost six times lower TSS concentration than raw wastewater (Table 2). The absence of particulate matter inside the feed could be the reason for smoother granule surface observed at Stage 2. Inorganic particulate structures in the raw

wastewater that attached to granules at Stage 1 could be seen on the surface of the granules Fig. 4(a).

Similar peaks were recorded for the FTIR spectrum of the granule surfaces at each stage (Fig. 5). At Stage 2 and Stage 3, stronger peaks were observed at  $3276 \text{ cm}^{-1}$  and  $1636 \text{ cm}^{-1}$  indicating polysaccharide and protein structures, respectively (Li et al., 2015b; Isik et al., 2019). The broad region of transmittance between  $3600$  and  $3000 \text{ cm}^{-1}$  might be caused by O–H stretching of hydroxyl functional groups (Kumar et al., 2006). C–H stretching was probably responsible for peaks at  $2925 \text{ cm}^{-1}$  at each stage (Bramhachari et al., 2007). Peaks at  $3276 \text{ cm}^{-1}$  (O–H stretching),  $2925 \text{ cm}^{-1}$  (weak C–H stretching), and  $1636 \text{ cm}^{-1}$  (asymmetric stretching of O–C–O) indicated EPS structures in the granules (Lin et al., 2010, 2013). Weak peaks at  $1240 \text{ cm}^{-1}$  (attributed to nucleic acids due to a band of phosphate group absorption) might also be caused by EPS presence in the granules (Sheng et al., 2006; Lin et al., 2010). Strong peaks at  $1029 \text{ cm}^{-1}$  (C–OH stretching) represented polysaccharides (Allen et al., 2004; Low et al., 2021).

EPS is considered as a material acting like gelatin, which functions as a network for microorganisms to grow (Flemming et al., 2007). Therefore, the interaction between EPS and microbial cells affects the formation of granular sludge (Ni, 2013). FTIR results indicated EPS presence at all stages. pEPS and cEPS measurements are given in Table 3. The highest pEPS formation was measured at Stage 3. At Stage 1 and Stage 2, similar values have been obtained. cEPS amounts were close to each other at all stages. Therefore, pEPS/cEPS ratio of granules was different at each stage. A higher pEPS/cEPS ratio indicates better granulation (Zhang et al., 2017). Consistent with the literature, it was observed that the pEPS/cEPS ratio correlated with granule size ( $p: 0.01$ ;  $r: 0.93$ ), and the highest pEPS/cEPS ratio observed at Stage 3 ( $d_{50}$  value:  $153 \pm 11 \mu\text{m}$ ).

### 3.3. Overall evaluation

In this study, AGS system was fed with influent with different characteristics in each stage. That is why instead of pollutant removal efficiencies, EQI was used to compare the treatment performance of different stages. EQI was calculated by using the selected specific weighting factors for the concentrations of TSS, COD,  $\text{NO}_3\text{-N}$ , TKN, and TP parameters in the effluent at each stage. EQI was found as 6.6 g pollution/d, 7.8 g pollution/d and 5.4 g pollution/d at Stage 1, Stage 2 and Stage 3, respectively. Fig. 6 compares different stages in terms of EQI and sludge characteristics ( $d_{50}$ , pEPS/cEPS, and normalized CST values). The best effluent quality, with the highest  $d_{50}$  value and pEPS/cEPS ratio of the sludge, was obtained in Stage 3. Higher pEPS/cEPS ratio (Table 3) could be the reason of increased granule size. At Stage 1

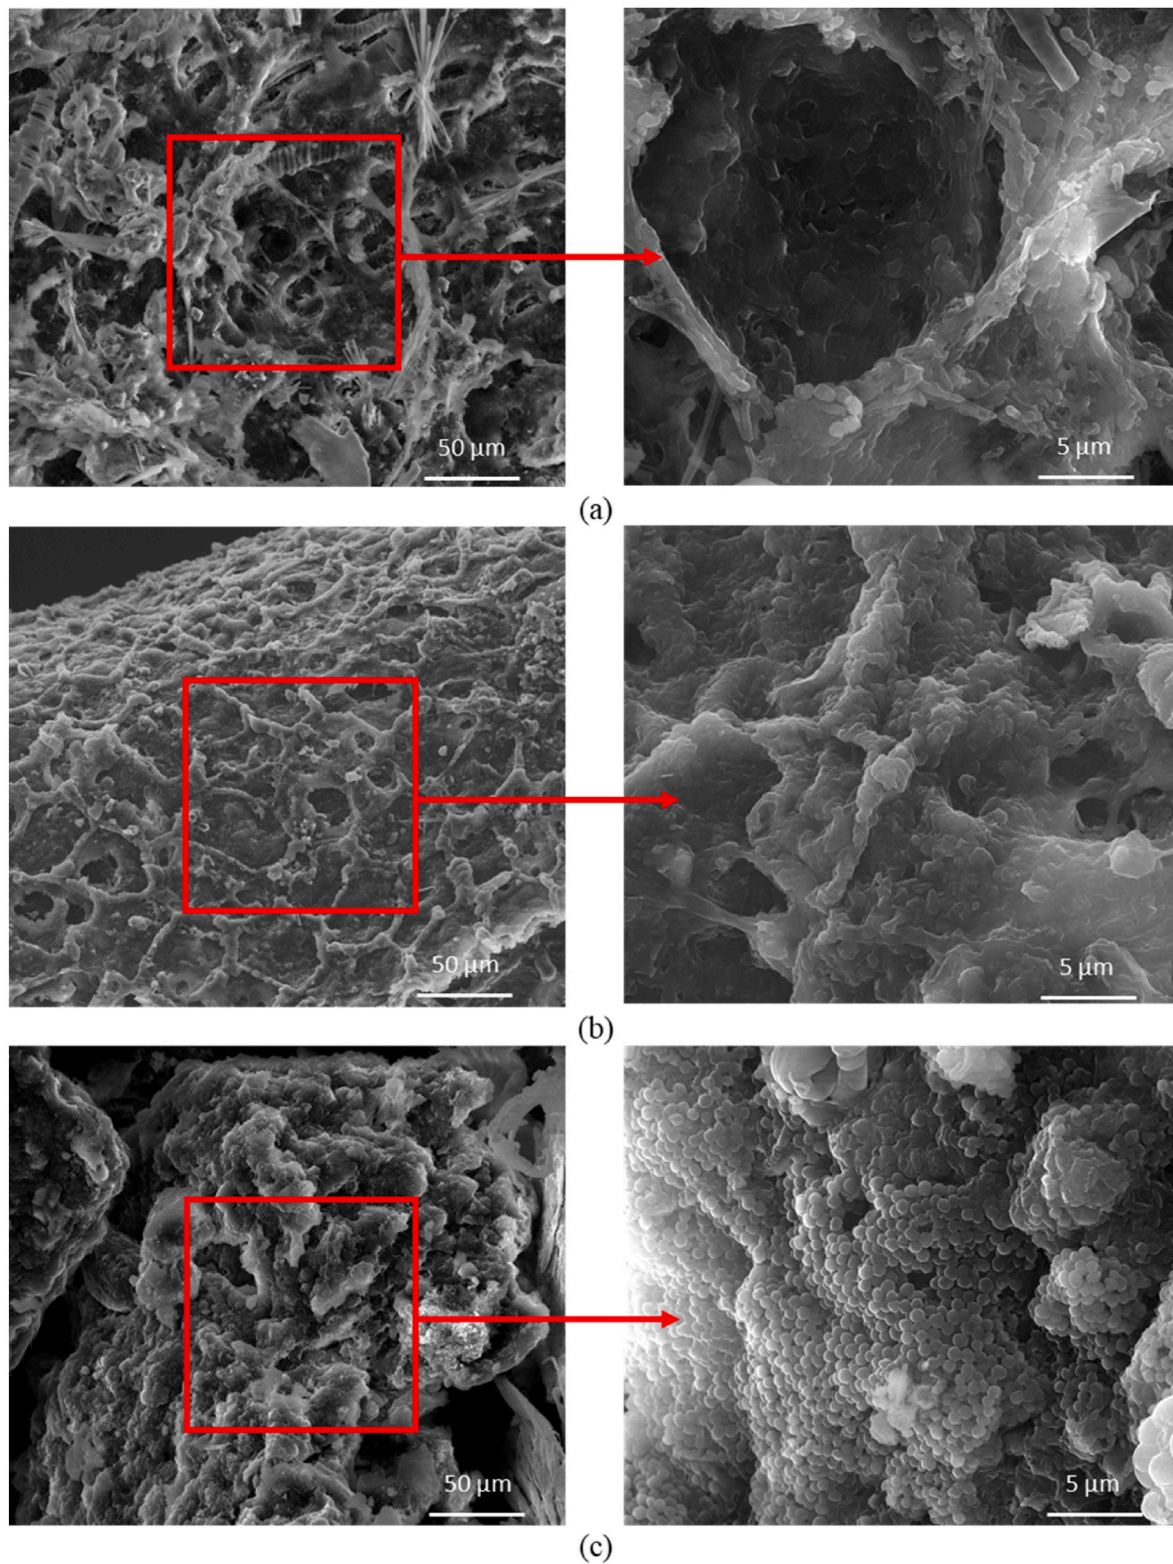


Fig. 4. ESEM images of granules: (a) Stage 1, (b) Stage 2, (c) Stage 3.

and Stage 2, similar pEPS/cEPS ratios correlated with similar  $d_{50}$  values. The lowest normalized CST, that was observed at Stage 3, would reduce chemical consumption in sludge handling facilities. The worst effluent quality was observed at Stage 2. The lowest influent COD/TN ratio might cause a decrease in the denitrification capacity of the granules at Stage 2. Considering overall evaluation, influent COD/TN ratio was found to be an important parameter that affects nitrogen removal in AGS

process. In this study, the HRAS process effluent and raw wastewater were mixed to reduce the inlet pollutant load for the AGS process, while providing sufficient carbon for the denitrifiers and PAOs, thus balancing between capturing the carbon in the wastewater via HRAS process and obtaining high quality effluent in the AGS system was shown to be achievable. Moreover, recovering the energy from carbon captured by HRAS system would decrease the net energy consumption of the system



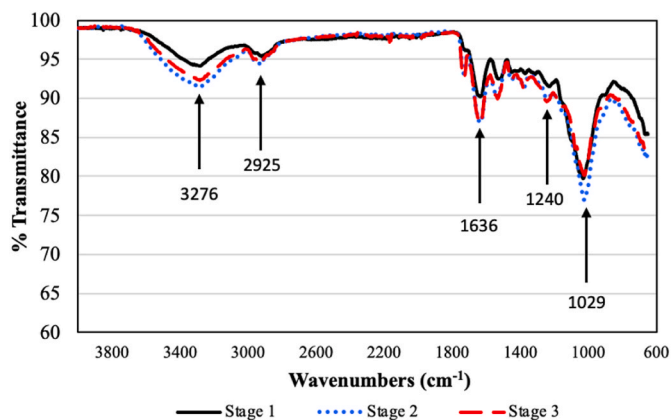


Fig. 5. FTIR spectrum of granules at each stage.

Table 3  
PEPS and cEPS measurements, and pEPS/cEPS ratio at each stage.

Parameter	Unit	Stage 1 (Average $\pm$ SD)	Stage 2 (Average $\pm$ SD)	Stage 3 (Average $\pm$ SD)
pEPS	mg/g VSS	51 $\pm$ 4	56 $\pm$ 2	75 $\pm$ 6
cEPS	mg/g VSS	24 $\pm$ 2	30 $\pm$ 1	27 $\pm$ 4
pEPS/cEPS ratio	(mg pEPS/ gVSS)/(mg cEPS/gVSS)	2.14 $\pm$ 0.11	1.85 $\pm$ 0.09	2.80 $\pm$ 0.24

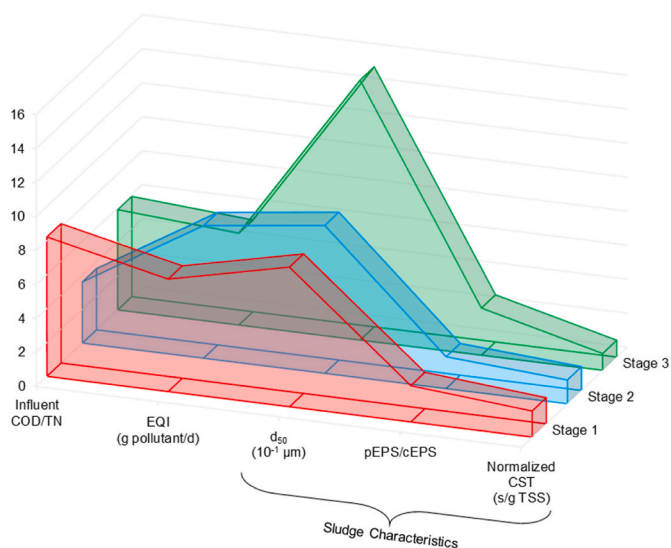


Fig. 6. Comparison of different stages in terms of EQI,  $d_{50}$ , pEPS/cEPS, and normalized CST.

that couples HRAS and AGS processes. Compared to conventional activated sludge systems, AGS process has 50% less energy consumption (Sengar et al., 2018). This makes selecting AGS process to remove nutrients after HRAS process instead of conventional activated sludge process more desirable. Regarding the coupling of HRAS process with AGS process, in order to increase denitrification performance of the system, use of volatile fatty acids (VFA) produced after fermentation of waste sludge of HRAS instead of raw wastewater in the mixing with HRAS process effluent should be investigated in the future. VFAs have shown to be an affective carbon source for granulation, phosphorus removal, and simultaneous nitrification/denitrification (Franca et al., 2018).

#### 4. Conclusions

In this study, the performance of AGS process fed with HRAS process effluent was investigated with the aim of increasing energy recovery potential from wastewater without compromising effluent quality. AGS process was fed with raw municipal wastewater, with the effluent of HRAS process, and with the mixture of the effluent of HRAS process and raw wastewater. Although feeding the AGS process with the effluent of HRAS process lowered the influent pollution load to AGS process, low COD/TN ratio in the influent limited denitrification and caused high nitrate concentration in the effluent. The mixture of the effluent of HRAS process and raw wastewater as substrate for the AGS process increased denitrification efficiency of the system, since sufficient carbon was provided for denitrifiers with increased COD/TN ratio. The granular sludge in this system had the largest diameter, which likely also contributed to extra simultaneous nitrification/denitrification in the system. This study showed that feeding the AGS system with a mixture of HRAS process effluent and raw wastewater may be a suitable option for the treatment of municipal wastewater, while maximizing energy recovery.

#### CRediT author statement

**Sadiye Kosar:** Conceptualization, Methodology, Investigation, Writing - Review & Editing. **Onur Isik:** Conceptualization, Investigation, Validation, Writing - Original Draft, Writing - Review & Editing. **Busra Cicekalan:** Investigation. **Hazal Gulhan:** Conceptualization, Methodology, Writing - Original Draft, Writing - Review & Editing. **Seyma Cingoz:** Project administration, Funding acquisition. **Mustafa Yoruk:** Project administration, Funding acquisition. **Hale Ozgun:** Conceptualization, Supervision, Validation, Writing - Original Draft, Writing - Review & Editing, Project administration. **Ismail Koyuncu:** Resources, Writing - Review & Editing. **Mark C.M. van Loosdrecht:** Writing - Review & Editing. **Mustafa Evren Ersahin:** Conceptualization, Supervision, Validation, Writing - Original Draft, Writing - Review & Editing, Project administration.

#### Declaration of competing interest

The authors declare that they have no known competing financial interests or personal relationships that could have appeared to influence the work reported in this paper.

#### Data availability

The authors are unable or have chosen not to specify which data has been used.

#### Acknowledgement

The authors would like to express their gratitude for the PhD Fellowship provided by YOK 100/2000 Scholarship Programme to Sadiye Kosar, by the Council of Higher Education of Turkey. This study was supported by Scientific Research Projects Department of Istanbul Technical University (Project No: MDK-2019-42173). This research was funded by Istanbul Water and Sewerage Administration (ISKI) with the project titled as "Treatment of Wastewaters from ISKI Baltalimani Wastewater Treatment Plant by Aerobic Granular Sludge System in Low Cost and Low Footprint".

#### References

- Adav, S.S., Lee, D.J., Show, K.Y., Tay, J.H., 2008. Aerobic granular sludge: recent advances. *Biotechnol. Adv.* 26, 411–423.
- Allen, M.S., Welch, K.T., Prebyl, B.S., Baker, D.C., Meyers, A.J., Sayler, G.S., 2004. Analysis and glycosyl composition of the exopolysaccharide isolated from the floc-

- forming wastewater bacterium *Thauera* sp. MZ1T. *Environ. Microbiol.* 6 (8), 780–790.
- APHA, 2017. Standard Methods for Examination of Water and Wastewater, 23<sup>rd</sup> edition. American Public Health Association, Washington.
- Bathe, S., de Kreuk, M.K., McSwain, B., Schwarzenbeck, N., 2005. *Aerobic Granular Sludge*. IWA Publishing, ISBN 1-84339-509-6.
- Bengtsson, S., de Blois, M., Wilen, B.M., Gustavsson, D., 2018. Treatment of municipal wastewater with aerobic granular sludge. *Crit. Rev. Environ. Sci. Technol.* 48 (2), 119–166.
- Bohnke, B., 1983. Development of a competitive two-stage biological treatment system - results of pilot plants and full-scale plants. Scale-Up of Water and Wastewater Treatment Processes 419–432, 0-250-40638-1.
- Bramhachari, P.V., Kavikishor, P.B.K., Ramadevi, R., Kumar, R., Rao, B.R., Dubey, S.K., 2007. Isolation and characterization of mucous exopolysaccharide (EPS) produced by *Vibrio furnissii* strain VB0S3. *J. Microbiol. Biotechnol.* 17, 14–51.
- Chen, K.H., Wang, H.C., Han, J.L., Liu, W.Z., Cheng, H.Y., Liang, B., Wang, A.J., 2020. The application of footprints for assessing the sustainability of wastewater treatment plants: a review. *J. Clean. Prod.* 277, 124053.
- Copp, J.B., 2002. The COST Simulation Benchmark: Description and Simulator Manual. Office for official publications of the European Community, Luxembourg.
- de Graaff, M.S., van den Brand, T.P., Roest, K., Zandvoort, M.H., Duin, O., van Loosdrecht, M.C.M., 2016. Full-scale highly-loaded wastewater treatment processes (A-stage) to increase energy production from wastewater: performance and design guidelines. *Environ. Eng. Sci.* 33 (8), 571–577.
- de Kreuk, M.K., Kishida, N., van Loosdrecht, M.C.M., 2007. Aerobic granular sludge – state of the art. *Water Sci. Technol.* 55 (8–9), 75–81.
- de Kreuk, M.K., Heijnen, J.J., van Loosdrecht, M.C.M., 2005. Simultaneous COD, nitrogen, and phosphate removal by aerobic granular sludge. *Biotechnol. Bioeng.* 90, 761–769.
- Dubois, M., Gilles, K.A., Hamilton, J.K., Rebers, P.A., Smith, F., 1956. Colorimetric method for determination of sugars and related substances. *Anal. Chem.* 28, 350–356.
- Felz, S., Al-Zuhairy, S., Aarstad, O.A., van Loosdrecht, M.C.M., Lin, Y.M., 2016. Extraction of structural extracellular polymeric substances from aerobic granular sludge. *JoVE* 115, e54534.
- Ferreira, T.J.T., de Sousa Rollemberg, S.L., de Barros, A.N., de Lima, J.P.M., dos Santos, A.B., 2021. Integrated review of resource recovery on aerobic granular sludge systems: possibilities and challenges for the application of the biorefinery concept. *J. Environ. Manag.* 291, 112718.
- Flemming, H.-C., Neu, T.R., Wozniak, D.J., 2007. The EPS matrix: the “House of biofilm cells”. *J. Bacteriol.* 189 (22), 7945–7947.
- Franca, R.D.G., Pinheiro, H.M., van Loosdrecht, M.C.M., Lourenço, N.D., 2018. Stability of aerobic granules during long-term bioreactor operation. *Biotechnol. Adv.* 36, 228–246.
- Frolund, B., Griebe, T., Nielsen, P.H., 1995. Enzymatic activity in the activated sludge floc matrix. *Appl. Microbiol. Biotechnol.* 43, 755–761.
- Gernaey, K.V., Jorgensen, S.B., 2004. Benchmarking combined biological phosphorus and nitrogen removal wastewater treatment processes. *Control Eng. Pract.* 12, 357–373.
- Giesen, A., Thompson, A., 2013. Aerobic Granular Biomass for Cost-Effective, Energy Efficient and Sustainable Wastewater Treatment. 7<sup>th</sup> European Waste Water Management Conference.
- Güven, H., Ersahin, M.E., Dereli, R.K., Özgün, H., Sancar, D., Öztürk, I., 2017. Effect of hydraulic retention time on the performance of high rate activated sludge system: a pilot-scale study. *Water, Air, Soil Pollut.* 228 (417), 1–10.
- Güven, H., Dereli, R.K., Özgün, H., Ersahin, M.E., Öztürk, I., 2019. Towards sustainable and energy efficient municipal wastewater treatment by up-concentration of organics. *Prog. Energy Combust. Sci.* 70, 145–168.
- Hamza, R., Rabii, A., Ezzahraoui, F.Z., Morgan, G., Iorhemen, O.T., 2022. A review of the state of development of aerobic granular sludge technology over the last 20 years: full-scale applications and resource recovery. *Case Studies in Chemical and Environmental Engineering* 5, 100173.
- Isik, O., Abdelrahman, A.M., Özgün, H., Ersahin, M.E., Demir, I., Koyuncu, I., 2019. Comparative evaluation of ultrafiltration and dynamic membranes in an aerobic membrane bioreactor for municipal wastewater treatment. *Environ. Sci. Pollut. Control Ser.* 26, 32723–32733.
- Jenkins, D., Wanner, J., 2014. *Activated Sludge – 100 Years and Counting*, vol. 13. Water Intelligence Online.
- Kosar, S., Isik, O., Cicekalan, B., Gulhan, G., Kurt, E.S., Atli, E., Basa, S., Özgün, H., Koyuncu, I., van Loosdrecht, M.C.M., Ersahin, M.E., 2022. Impact of primary sedimentation on granulation and treatment performance of municipal wastewater by aerobic granular sludge process. *J. Environ. Manag.* 315, 115191.
- Kumar, M., Adham, S.S., Pearce, W.R., 2006. Investigation of seawater reverse osmosis fouling and its relationship to pretreatment type. *Environ. Sci. Technol.* 40, 2037–2044.
- Li, J., Ding, L., Bin, Cai, A., Huang, G.X., Horn, H., 2014. Aerobic sludge granulation in a full-scale sequencing batch reactor. *BioMed Res. Int.* <https://doi.org/10.1155/2014/268789>, 2014.
- Li, J., Liu, J., Wang, D.J., Chen, T., Ma, T., Wang, Z.H., Zhuo, W.L., 2015a. Accelerating aerobic sludge granulation by adding dry sewage sludge micropowder in sequencing batch reactors. *Int. J. Environ. Res. Publ. Health* 12 (8), 10056–10065.
- Li, K., Wei, D., Zhang, G., Shi, L., Wang, Y., Wang, B., Wang, X., Du, B., Wei, Q., 2015b. Toxicity of bisphenol A to aerobic granular sludge in sequencing batch reactors. *J. Mol. Liq.* 209, 284–288.
- Lin, Y., de Kreuk, M.K., van Loosdrecht, M.C.M., Adin, A., 2010. Characterization of alginate-like exopolysaccharides isolated from aerobic granular sludge in pilot-plant. *Water Res.* 44, 3355–3364.
- Lin, Y.M., Sharma, P.K., van Loosdrecht, M.C.M., 2013. The chemical and mechanical differences between alginate-like exopolysaccharides isolated from aerobic flocculent sludge and aerobic granular sludge. *Water Res.* 47, 57–65.
- Liu, Y., 2006. Mechanisms of aerobic granulation. In: *Biogranulation Technologies for Wastewater Treatment*. Pergamon, ISBN 9780080476087, pp. 85–98.
- Long, B., Yang, C.Z., Pu, W.H., Yang, J.K., Jiang, G.S., Dang, J.F., Li, C.Y., Liu, F.B., 2014. Rapid cultivation of aerobic granular sludge in a pilot scale sequencing batch reactor. *Bioresour. Technol.* 166, 57–63.
- Low, W.P., Din, M.F.M., Chang, F.L., Moideeni, S.N.F.B., Lee, Y.Y., Krishnan, S., 2021. Development of microbial biofilms on cellulosic fibers for organic matter removal in river water treatment. *Desalination Water Treat.* 224, 144–153.
- Maktabifard, M., Zaborowska, E., Makinia, J., 2018. Achieving energy neutrality in wastewater treatment plants through energy savings and enhancing renewable energy production. *Rev. Environ. Sci. Biotechnol.* 17, 655–689.
- Maktabifard, M., Zaborowska, E., Makinia, J., 2020. Energy neutrality versus carbon footprint minimization in municipal wastewater treatment plants. *Bioresour. Technol.* 300, 122647.
- Ni, B.J., 2013. Formation, Characterization and Mathematical Modeling of the Aerobic Granular Sludge. Doctoral Thesis. School of Earth and Space Sciences University of Science and Technology of China.
- Nguyen Quoc, B., Armenta, M., Carter, J.A., Bucher, R., Sukapantharam, P., Bryson, S.J., Stahl, D.A., Stensel, H.D., Winkler, M.K.H., 2021. An investigation into the optimal granular sludge size for simultaneous nitrogen and phosphate removal. *Water Res.* 198, 117119.
- Pronk, M., Giesen, A., Thompson, A., Robertson, S., van Loosdrecht, M.C.M., 2017. Aerobic granular biomass technology: advancements in design, applications and further developments. *Water Pract. Technol.* 12 (4), 987–996.
- Pronk, M., de Kreuk, M.K., de Bruin, B., Kamminga, P., Kleerebezem, R., van Loosdrecht, M.C.M., 2015. Full scale performance of the aerobic granular sludge process for sewage treatment. *Water Res.* 84, 207–217.
- Rahman, A., De Clippeleir, H., Thomas, W., Jimenez, J.A., Wett, B., Al-Omari, A., Murthy, S., Riffat, R., Bott, C., 2019. A-stage and high-rate contact-stabilization performance comparison for carbon and nutrient redirection from high-strength municipal wastewater. *Chem. Eng. J.* 357, 737–749.
- Rahman, A., Hasan, M., Meerburg, F., Jimenez, J.A., Miller, M.W., Bott, C.B., Al-Omari, A., Murthy, S., Shaw, A., De Clippeleir, H., Riffat, R., 2020. Moving forward with A-stage and high-rate contact-stabilization for energy efficient water resource recovery facility: mechanisms, factors, practical approach, and guidelines. *J. Water Proc. Eng.* 30, 101329.
- Sengar, A., Basheer, F., Aziz, A., Farooqi, I.H., 2018. Aerobic granulation technology: laboratory studies to full scale practices. *J. Clean. Prod.* 197, 616–632.
- Sheng, G.P., Yu, H.Q., Wang, C.M., 2006. FTIR-spectral analysis of two photosynthetic H<sub>2</sub>-producing strains and their extracellular polymeric substances. *Appl. Microbiol. Biotechnol.* 73, 204–210.
- Thwaites, B.J., Short, M.D., Stuetz, R.M., Reeve, P.J., Alvarez Gaitan, J.P., Dinesh, N., van den Akker, B., 2018. Comparing the performance of aerobic granular sludge versus conventional activated sludge for microbial log removal and effluent quality: implications for water reuse. *Water Res.* 145, 442–452.
- van Dijk, E.J.H., Haaksman, V.A., van Loosdrecht, M.C.M., 2022. On the mechanisms for aerobic granulation - model based evaluation. *Water Res.* 216, 118365.
- van Haandel, A., van der Lubbe, J., Design, S., 2015. *Handbook of biological wastewater treatment*. Nanotechnology 15, 01.
- van Loosdrecht, M.C.M., Brdjanovic, D., 2014. Anticipating the next century of wastewater treatment. *Science* 344 (6191), 1452–1453.
- van Loosdrecht, M.C.M., Nielsen, P.H., Lopez-Vazquez, C.M., Brdjanovic, D., 2016. *Experimental Methods in Wastewater Treatment*, first ed. IWA Publishing.
- Wan, J., Gu, J., Zhao, Q., Liu, Y., 2016. COD capture: a feasible option towards energy self-sufficient domestic wastewater treatment. *Sci. Rep.* 6, 25054.
- Wang, X., Liu, J., Ren, N.Q., Duan, Z., 2012. Environmental profile of typical anaerobic/anoxic/oxic wastewater treatment systems meeting increasingly stringent treatment standards from a life cycle perspective. *Bioresour. Technol.* 126, 31–40.
- Winkler, M.K.H., Le, Q.H., Volcke, E.I.P., 2015. Influence of partial denitrification and mixotrophic growth of nob on microbial distribution in aerobic granular sludge. *Environ. Sci. Technol.* 49, 11003–11010.
- Yan, P., Shi, H.X., Chen, Y.P., Gao, X., Fang, F., Guo, J.S., 2020. Optimization of recovery and utilization pathway of chemical energy from wastewater pollutants by a net-zero energy wastewater treatment model. *Renew. Sustain. Energy Rev.* 133, 110160.
- Zaborowska, E., Czerwionka, K., Makinia, J., 2021. Integrated plant-wide modelling for evaluation of the energy balance and greenhouse gas footprint in large wastewater treatment plants. *Appl. Energy* 282, 116126.
- Zhang, D., Sun, Y., Angelotti, B., Wang, Z.W., 2020. Understanding the dewaterability of aerobic granular sludge formed in continuous flow bioreactors treating real domestic wastewater: is it really better than that of activated sludge? *J. Water Proc. Eng.* 36, 101253 <https://doi.org/10.1016/j.jwpe.2020.101253>.
- Zhang, D., Wang, L., Cheng, H., Jinyou, S., Xinbai, J., Wuyun, S., Jiansheng, L., Weiqing, H., Lianjun, W., Xiaodong, L., 2017. Aerobic granulation accelerated by biochar for the treatment of refractory wastewater. *Chem. Eng. J.* 314, 88–97.