

## **Arsenic removal from iron-containing groundwater by delayed aeration in dual-media sand filters**

Annaduzzaman, Md; Rietveld, Luuk C.; Amin Hoque, Bilqis ; Bari, Md Niamul; van Halem, Doris

**DOI**

[10.1016/j.jhazmat.2020.124823](https://doi.org/10.1016/j.jhazmat.2020.124823)

**Publication date**

2021

**Document Version**

Final published version

**Published in**

Journal of Hazardous Materials

**Citation (APA)**

Annaduzzaman, M., Rietveld, L. C., Amin Hoque, B., Bari, M. N., & van Halem, D. (2021). Arsenic removal from iron-containing groundwater by delayed aeration in dual-media sand filters. *Journal of Hazardous Materials*, 411, Article 124823. <https://doi.org/10.1016/j.jhazmat.2020.124823>

**Important note**

To cite this publication, please use the final published version (if applicable). Please check the document version above.

**Copyright**

Other than for strictly personal use, it is not permitted to download, forward or distribute the text or part of it, without the consent of the author(s) and/or copyright holder(s), unless the work is under an open content license such as Creative Commons.

**Takedown policy**

Please contact us and provide details if you believe this document breaches copyrights. We will remove access to the work immediately and investigate your claim.



## Arsenic removal from iron-containing groundwater by delayed aeration in dual-media sand filters

Md Annaduzzaman<sup>a,\*</sup>, Luuk C. Rietveld<sup>a</sup>, Bilqis Amin Hoque<sup>b</sup>, Md Niamul Bari<sup>c</sup>, Doris van Halem<sup>a</sup>

<sup>a</sup> Sanitary Engineering Section, Department of Water Management, Delft University of Technology, The Netherlands

<sup>b</sup> Environment and Population Research Center, Bangladesh

<sup>c</sup> Department of Civil Engineering, Rajshahi University of Engineering and Technology, Bangladesh

### ARTICLE INFO

#### Keywords:

Anoxic storage  
Arsenic removal  
Sand filtration  
Drinking water treatment

### ABSTRACT

Generally, abstracted groundwater is aerated, leading to iron ( $\text{Fe}^{2+}$ ) oxidation to  $\text{Fe}^{3+}$  and precipitation as  $\text{Fe}^{3+}$ - (hydr)oxide (HFO) flocs. This practice of passive groundwater treatment, however, is not considered a barrier for arsenic (As), as removal efficiencies vary widely (15–95%), depending on Fe/As ratio. This study hypothesizes that full utilization of the adsorption capacity of groundwater native- $\text{Fe}^{2+}$  based HFO flocs is hampered by rapid  $\text{Fe}^{2+}$  oxidation-precipitation during aeration before or after storage. Therefore, delaying  $\text{Fe}^{2+}$  oxidation by the introduction of an anoxic storage step before aeration-filtration was investigated for As(III) oxidation and removal in Rajshahi (Bangladesh) with natural groundwater containing  $329(\pm 0.05) \mu\text{gAs/L}$ . The results indicated that As(III) oxidation in the oxic storage was higher with complete and rapid  $\text{Fe}^{2+}$  oxidation ( $2\pm 0.01 \text{ mg/L}$ ) than in the anoxic storage system, where  $\text{Fe}^{2+}$  oxidation was partial ( $1.03\pm 0.32 \text{ mg/L}$ ), but the oxidized As(V)/Fe removal ratio was comparatively higher for the anoxic storage system. The low pH (6.9) and dissolved oxygen (DO) concentration ( $0.24 \text{ mg/L}$ ) in the anoxic storage limited the rapid oxidation of  $\text{Fe}^{2+}$  and facilitated more As(V) removal. The groundwater native- $\text{Fe}^{2+}$  ( $2.33\pm 0.03 \text{ mg/L}$ ) removed 61% of As in the oxic system (storage-aeration-filtration), whereas 92% As removal was achieved in the anoxic system.

### 1. Introduction

Groundwater arsenic (As) contamination is a severe drinking water quality problem and a threat to human health in Bangladesh and other countries (Smedley and Kinniburgh, 2002; Chakraborti et al., 2013). Chronic exposure to As-contaminated drinking water has resulted in tens of millions of people suffering from skin lesions, hyperkeratosis, melanosis, skin cancer, and cancer of internal organs (Luzi et al., 2004; Li et al., 2012; Guo et al., 2013). The World Health Organization (WHO) recommends that As concentrations in drinking water should not be more than  $10 \mu\text{g/L}$  (Smith et al., 2000). However, according to Bangladesh Drinking Water Standard (BDWS), the recommended value for As in drinking water is  $50 \mu\text{g/L}$ . Nevertheless, groundwater in an extended area of Bangladesh contains As concentrations higher than those recommended values (Rosso et al., 2011; Perez and Francisca, 2013; Haque et al., 2018), and sometimes, it even exceeds  $1500 \mu\text{gAs/L}$  (Nordstrom, 2002; Cavalca et al., 2019). In reducing groundwater, at near-neutral pH, As exists in the thermodynamically stable form as

arsenite or As(III) ( $\text{H}_3\text{AsO}_3$ ) (Cullen and Reimer, 1989; Smedley and Kinniburgh, 2002), while, in oxidizing conditions, arsenate or As(V) is the predominant species ( $\text{H}_2\text{AsO}_4^-$ ,  $\text{HAsO}_4^{2-}$ ) (Lafferty et al., 2010; Villalobos et al., 2014). Various treatment technologies, including adsorption, coagulation/flocculation, chemical precipitation, lime softening, ion-exchange, and membrane filtration have been studied to remove As from water (Meng et al., 2001; Su and Puls, 2001; Roberts et al., 2004; Zhang et al., 2010; Pio et al., 2015; Niazi et al., 2018; Shakoor et al., 2019; Amen et al., 2020). However, these options are energy-intensive, and/or consume chemicals that make the treatment methods expensive (Hoque et al., 2004, 2006; Hossain et al., 2014). In addition, commonly available treatment systems are complicated to operate and maintain, needing regular parts' replacement and after-market services that are expensive and skilled personnel who may not be locally available (Delaire et al., 2017). As a consequence, these technologies are not sustainable in the long run in vulnerable communities (Hossain et al., 2014, 2015).

Therefore, there is a need for simple, economical, and energy-

\* Corresponding author.

E-mail address: [M.Annaduzzaman@tudelft.nl](mailto:M.Annaduzzaman@tudelft.nl) (M. Annaduzzaman).

<https://doi.org/10.1016/j.jhazmat.2020.124823>

Received 21 August 2020; Received in revised form 23 November 2020; Accepted 8 December 2020

Available online 11 December 2020

0304-3894/© 2020 The Author(s). Published by Elsevier B.V. This is an open access article under the CC BY license (<http://creativecommons.org/licenses/by/4.0/>).

efficient alternatives, utilizing locally available materials and less or no use of additional chemicals (Katsoyiannis et al., 2015; Hering et al., 2017; Senn et al., 2018). Passive groundwater treatment consists of aeration, followed by single or multiple filtration steps (Morrison et al., 2002; Roberts et al., 2004) without using chemicals, as shown in Fig. 1. Aeration frequently consists of cascades or spray aerators, followed by gravitational filtration through a submerged filter bed. Traditionally, passive groundwater treatment is used for the removal of  $\text{Fe}^{2+}$ , ammonium ( $\text{NH}_4^+$ ), and manganese ( $\text{Mn}^{2+}$ ) (Katsoyiannis et al., 2008a, 2008b; Bruins et al., 2014; Vries et al., 2017). However, this treatment method is not considered a robust barrier for As, as its removal efficiencies typically vary widely between 15% and 95% (Lowry and Lowry, 2002; Sorlini and Gialdini, 2010; Gude et al., 2016), depending on the water chemistry (Sorlini and Gialdini, 2014). Co-removal of As with groundwater native-Fe is reported to be only possible if As concentration is low ( $<50 \mu\text{g/L}$ ) (Katsoyiannis et al., 2015; Gude et al., 2018a) and the Fe to As ratio is sufficiently high (Biswas et al., 2012; Sharma et al., 2016; Annaduzzaman et al., 2018). Furthermore, studies by Holm and Wilson (2006) showed that despite having groundwater native- $\text{Fe}^{2+}$  of  $>1.5 \text{ mg/L}$ , only 20–25% (8–10  $\mu\text{g/L}$ ) of As could be removed. This was also the case in Lowry and Lowry's (2002) study that showed aeration and storage of  $\text{Fe}^{2+}$  containing groundwater, facilitated only partial As removal with hydrous ferric oxide (HFO) flocs. Roberts et al. (2004) also revealed that 50–55  $\text{mg/L}$  of  $\text{Fe}^{2+}$  was required to achieve  $<50 \mu\text{g/L}$  As in the treated solution from 500  $\mu\text{g/L}$  of As in a single-step  $\text{Fe}^{2+}$  oxidation system, while in a step-wise  $\text{Fe}^{2+}$  oxidation system, only 20–25  $\text{mg/L}$  of  $\text{Fe}^{2+}$  was sufficient to have an efficiency of over 90% As removal. All of these studies underline that the ratio of Fe to As played a major role in the As removal process.

Equilibrium adsorption studies of As on Fe oxides show that although both As(III) and As(V) have an affinity for Fe oxides (Dixit and Hering, 2003; Hug and Leupin, 2003; Voegelin and Hug, 2003; Luzi et al., 2004; Han et al., 2016), during  $\text{Fe}^{2+}$  oxidation and subsequent fresh HFO formation, the removal capacity for As(V) is much higher (Manning et al., 2002; Mercer and Tobiasson, 2008; Hering et al., 2017). The removal of As(III) is more efficient through co-precipitation, while As(V) removal is related to surface complexation/precipitation with HFO flocs (Tian et al., 2017). Therefore, in order to develop passive groundwater treatment into an efficient system for As removal by HFO flocs, it is critical to promote the presence of As in the oxidized As(V) state during onset  $\text{Fe}^{2+}$  oxidation.

In this study, it was hypothesized that by delaying the oxidation of groundwater native- $\text{Fe}^{2+}$ , the available adsorption capacity of the

freshly formed HFO flocs can be utilized better for sufficient As removal. Therefore, anoxic storage before aeration and filtration was applied to allow step-wise  $\text{Fe}^{2+}$  oxidation. This novel oxidation sequence was compared against a conventional oxidic storage system, to study the influence on As removal efficiency by delayed/step-wise oxidation followed by aeration and dual-media sand filtration. Moreover, in this treatment system, locally available filter materials were used without additional adsorbents/chemicals. The study was conducted in Rajshahi (Bangladesh), using naturally As-contaminated groundwater ( $329 \pm 0.05 \mu\text{g/L}$ ) in the presence of other inorganic groundwater contaminants (e.g.,  $\text{Fe}^{2+}$ ,  $\text{PO}_4^{3-}$ ,  $\text{NH}_4^+$ ).

## 2. Materials and methods


### 2.1. Water quality

The pilot-scale experiments were conducted using As contaminated groundwater in Uttar Kazirpara village in Paba Upazila of Rajshahi district, Bangladesh. Table 1 provides the relevant water quality parameters of used natural groundwater. The groundwater was in a reducing/anoxic state and abstracted from  $50(\pm 1) \text{ m}$  depth using an electric submersible pump (GAZI, Bangladesh).

**Table 1**

Raw groundwater quality in the shallow well that used as an influent for the pilot experiments.

Water Quality Parameters	Unit	Raw Groundwater
pH	[-]	6.94 $\pm$ 0.08(SD)
Dissolved Oxygen (DO)	mg/L	0.07 $\pm$ 0.06(SD)
Oxygen Reduction Potential (ORP)	mV	-110 $\pm$ 4(SD)
Electrical Conductivity (EC)	$\mu\text{S/cm}$	675 $\pm$ 6(SD)
Temperature	$^{\circ}\text{C}$	26.7 $\pm$ 1(SD)
As(total)	$\mu\text{g/L}$	329 $\pm$ 0.05(SD)
As(V)	$\mu\text{g/L}$	39 $\pm$ 0.02(SD)
As(III)	$\mu\text{g/L}$	290 $\pm$ 0.02(SD)
Iron ( $\text{Fe}^{2+}$ )	mg/L	2.33 $\pm$ 0.03(SD)
Manganese (Mn)	$\mu\text{g/L}$	600 $\pm$ 0.04(SD)
Magnesium (Mg)	mg/L	13.93 $\pm$ 0.22(SD)
Calcium (Ca)	mg/L	69.96 $\pm$ 1.07(SD)
Ammonium ( $\text{NH}_4^+$ )	mg/L	0.96 $\pm$ 0.02(SD)
Nitrate ( $\text{NO}_3^-$ )	mg/L	0.39 $\pm$ 0.02(SD)
Silicate ( $\text{SiO}_4^{4-}$ )	mg/L	28.5 $\pm$ 2.04(SD)
Phosphate ( $\text{PO}_4^{3-}$ )	mg/L	2.15 $\pm$ 0.03 (SD)

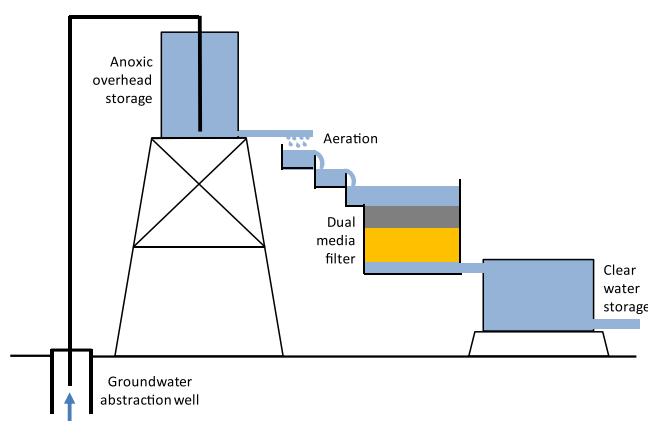

**Fig. 1.** The concept of delayed aeration by application of an anoxic storage container before aeration and dual-bed filtration.

## 2.2. Experimental set-up

The experimental set-up consisted of four identical dual-media filter columns to run the two parallel experiments in duplicate (Fig. 2). The As (III) oxidation and removal were investigated with two different storage conditions from the same source water: (1) conventional oxic storage and (2) anoxic storage. The oxic storage container was equipped with a spray aerator placed 35 cm above the container, whereas the anoxic storage container had an inlet at the bottom of the container – preventing any atmospheric contact. On the first day, the systems were allowed to overflow for 5 min to remove atmospheric oxygen. On the subsequent days, groundwater was added to the remaining stored water (about one-third of the volume), to refill the storage systems.

After storage, the water was aerated by letting it drip into the column from the pipeline, which was placed 35 cm above the top of the supernatant level of the column (Fig. 2). Each column has a diameter of 10 cm and a height of 120 cm. The columns were filled with 40(±2%) cm anthracite (0.6–0.9 mm) on top followed by 50(±2%) cm of quartz sand (0.3–0.75 mm) at the bottom. The quartz sand (known as Domar sand) is commonly used in construction, and gravel packing of the screen during tubewell installation. The Domar sand was bought from locally available shops. Before starting the experiment, the filter columns were extensively backwashed until the supernatant was visually clear. The experimental flow rate was set to 9 L/h to achieve a filtration velocity of 1 (±10%) m/h. The supernatant water level was kept at 15–20 cm above the filter bed, when the level rose beyond 20 cm due to filter clogging, backwashing was done.

Backwashing was executed with a 20% expansion of the filter bed using stored water and continued until the supernatant water was visually clear (±20 min). No chemicals were used during the experiments. Throughout the experimental period of 30 days, the column was continuously fed with water and covered to protect the water from direct sunlight exposure. The water quality of the different storage containers, supernatant, anthracite filtrate and column filtrate were compared for

30 days, and all experiments were performed in duplicates.

## 2.3. Sampling and analytical procedure

The parameters pH, dissolved oxygen (DO), oxidation-reduction potential (ORP), and temperature (T) were directly measured on-site during sample collections using WTW electrodes (SenTix 940, FDO®925, SenTix ORP 900, and Terracon 925, respectively). Samples were collected on days 1, 5, 10, 20, and 30. The filtered and unfiltered 15 ml water samples were collected in polypropylene transparent 15 ml centrifuge tubes (Sigma Aldrich) and the relevant samples were acidified immediately in the field for preservation until further analysis. The samples were acidified with ultrapure HNO<sub>3</sub> acid (ACS reagent, 70%; Formula weight 60.01 g/mol; Sigma Aldrich) that made up for 1.5% of the total solution. Furthermore, 250 ml filtered (0.45 µm) and non-acidified water samples were collected in 250 ml polypropylene laboratory-grade water vials for determining ammonium (NH<sub>4</sub><sup>+</sup>), nitrate (NO<sub>3</sub><sup>-</sup>), and phosphate (PO<sub>4</sub><sup>3-</sup>) concentrations. All filtered samples were filtered using a polyether-sulfone 0.45 µm filter (25 mm, VWR). Arsenic and Fe were analyzed using Inductively Coupled Plasma Mass Spectrometry (ICP-MS) in the water laboratory at the Delft University of Technology, the Netherlands. The concentration of NH<sub>4</sub><sup>+</sup>, NO<sub>3</sub><sup>-</sup>, and PO<sub>4</sub><sup>3-</sup> were determined from 250 ml filtered samples at Rajshahi Regional Laboratory, Department of Public Health Engineering (DPHE), Bangladesh.

The speciation of As(III) was conducted using the ion-exchange resin Amberlite® IRA-400 chlorite (Sigma Aldrich), by pushing 100 ml filtered (0.45 µm filter) water through a 60 ml syringe which contained 30 ml ion-exchange resin. After resin filtration, the remaining As concentrations were considered to be uncharged As(III) (Karori et al., 2006; Gude et al., 2016). The concentration of As(V) was calculated by deducting As(III) from the total As concentration obtained from the 0.45 µm filtered sample as mobile, dissolved As.

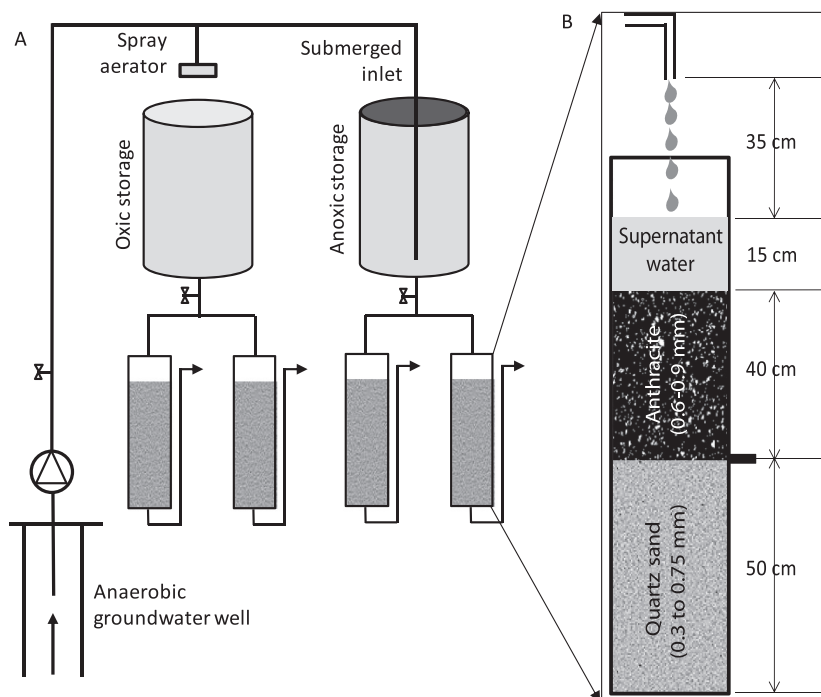


Fig. 2. Schematic overview of the dual-media sand filtration set-up. The anaerobic groundwater was exposed to atmospheric oxygen by a spray aerator before the oxic storage, whereas, the submerged inlet was used to fill the anoxic storage to avoid aeration. The pre-stored water was aerated by letting it drip into the column from the pipeline from 35 cm above the column top. The dual-media column experiments were performed in duplicates for each storage system.

## 2.4. Data analysis

The data analyses were conducted using one-way analysis of variance (ANOVA) with a confidence level of 95% ( $\alpha=0.05$ ) for the statistical validation of the removal efficiency of As, Fe,  $\text{NH}_4^+$ , and  $\text{PO}_4^{3-}$  during different filtration steps. The obtained duplicate data from each step and condition (oxic and anoxic) were used in duplicate assays from each sampling day ( $n=5$ ) over the experimental 30 days. The data were presented in the form of mean with their standard deviations. The p-value (probability value) from the ANOVA test was used to determine the significant difference between the duplicate results from the two different operational conditions (oxic and anoxic storage) followed by aeration and RSF steps. The analyzed p-value was consistently below 0.05 for As, Fe,  $\text{NH}_4^+$ , and  $\text{PO}_4^{3-}$  removal at different operational conditions and filtration steps, meaning the removal was statistically significant.

## 3. Results and discussion

### 3.1. $\text{Fe}^{2+}$ oxidation in the storage systems

The pH, DO, ORP, and  $\text{Fe}^{2+}$  concentrations in the oxic and anoxic storage systems are presented in Fig. 3. The natural groundwater pH, DO, and ORP were stable at  $6.94(\pm 0.2)$ ,  $0.07(\pm 0.06)$  mg/L, and  $-110(\pm 4)$  mV, respectively (Table 1). Due to aeration before storage in the oxic system, the pH, DO, and ORP increased to  $7.5(\pm 0.1)$ ,  $6.21(\pm 0.2)$  mg/L, and  $50(\pm 14)$  mV, correspondingly, since  $\text{CO}_2$  was stripped (i.e., pH increase) and  $\text{O}_2$  was added during aeration (Rahman, 2017). Furthermore, the aeration facilitated rapid oxidation of  $\text{Fe}^{2+}$  to  $\text{Fe}^{3+}$  and form HFO flocs. This was to be expected as the kinetics of homogeneous  $\text{Fe}^{2+}$  oxidation at pH 7.5 and high DO is fast ( $t_{1/2}$ : roughly 2–3 min) (Morgan and Lahav, 2007; Katsoyiannis et al., 2008a, 2008b). The total Fe concentration in the oxic storage system dropped slightly in the course of experiments and varied between 1.97 and 2.19 mg/L (Fig. 3d), which can be explained by the settling of HFO flocs in this non-stirred storage system. The 2.08 mg/L oxidized  $\text{Fe}^{3+}$  roughly corresponded to

the consumed DO of 0.30 mg/L, which was calculated based on the 1:4 stoichiometry of the  $\text{Fe}^{2+}$  oxidation reaction with DO (Stumm and Lee, 1961), illustrating that DO was the electron acceptor under the oxic conditions.

In the anoxic storage, the continuously low pH, DO, and ORP resulted in limited  $\text{Fe}^{2+}$  oxidation. However, the pH and DO remained low over days, whereas ORP increased slowly with increasing  $\text{Fe}^{2+}$  oxidation to  $\text{Fe}^{3+}$ . The pH and DO were found to be  $6.86(\pm 0.04)$ ,  $0.24(\pm 0.1)$  mg/L, respectively, but ORP drifted from  $-96.7$  mV on the first day to  $-45.7$  mV,  $-15.8$  mV,  $21.7$  mV, and  $48.6$  mV on days 5, 10, 20 and 30, correspondingly (Fig. 3c). From the graphs, the observed increase in pH, DO, and ORP on day 5 compared to day 1 could have resulted from the dilution effect of newly added water with remaining stored water (one-third of the volume). Due to the stable operation of the systems over days, the measurements stabilized from day 5–10 onwards (Fig. 3a,c). The oxidation of  $\text{Fe}^{2+}$  also increased over time from 0.64 mg/L of oxidized  $\text{Fe}^{3+}$  on the first day to 0.9 mg/L on day 30, where the  $\text{Fe}^{2+}$  oxidation rate in the anoxic storage was 0.8 mg/Lh and 0.12 mg/Lh on day 1 and 30 correspondingly.

During the filling of the anoxic storage, the introduction of DO into the abstracted groundwater could not be fully avoided, which probably led to partial oxidation of  $\text{Fe}^{2+}$ . However, the acceleration of  $\text{Fe}^{2+}$  oxidation over days in the anoxic storage is likely linked to either accumulation of  $\text{Fe}^{3+}$  hydroxides that catalyze the oxidation reaction (heterogeneous  $\text{Fe}^{2+}$  oxidation; van Beek et al., 2015) or development of  $\text{Fe}^{2+}$  oxidizing biofilm (biological  $\text{Fe}^{2+}$  oxidation) (de Vet et al., 2011; Lin et al., 2012; Uddin et al., 2019). Nevertheless,  $\text{Fe}^{2+}$  oxidation in the anoxic system was indeed suppressed throughout the experimental period, allowing for delayed/step-wise oxidation.

### 3.2. As(III) oxidation and removal in the storage systems

Arsenic concentration and speciation in the oxic and anoxic storage systems are presented in Fig. 4. Partial As(III) oxidation and As removal was observed in both storage systems with slightly more oxidation and removal in the oxic storage. The groundwater contained  $329(\pm 0.05)$   $\mu\text{g}/$


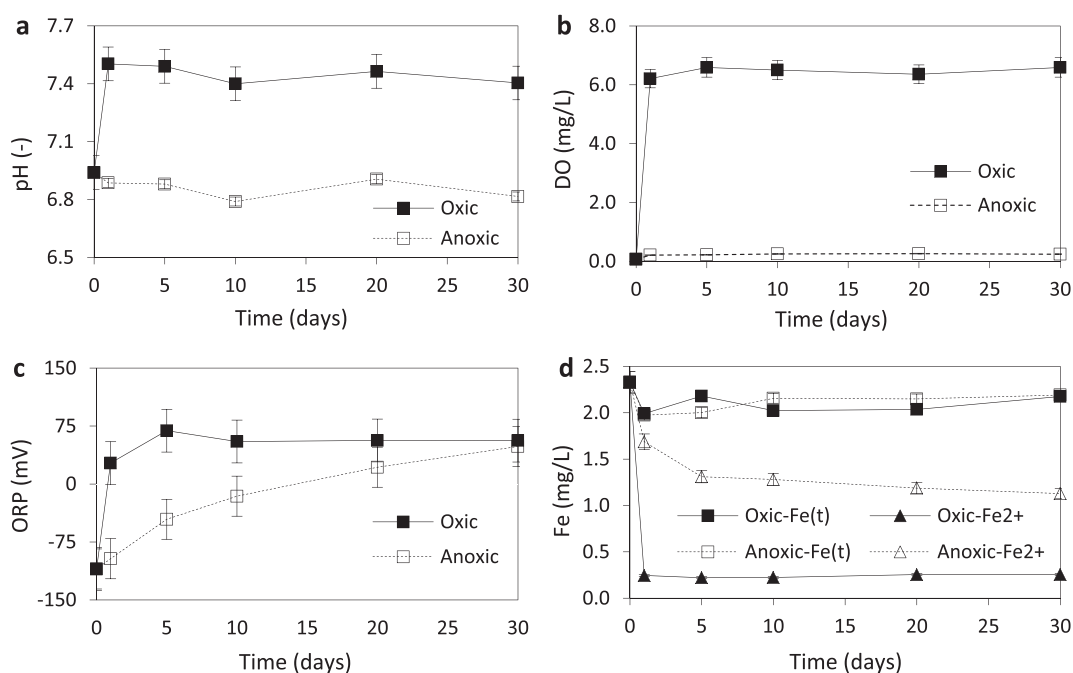


Fig. 3. (a) pH, (b) DO (c) ORP changes, and (d) the average concentration of  $\text{Fe}^{2+}$  and Fe(total) in the oxic and anoxic storage systems during the 30-day experimental period. The error bar represents the standard deviation.

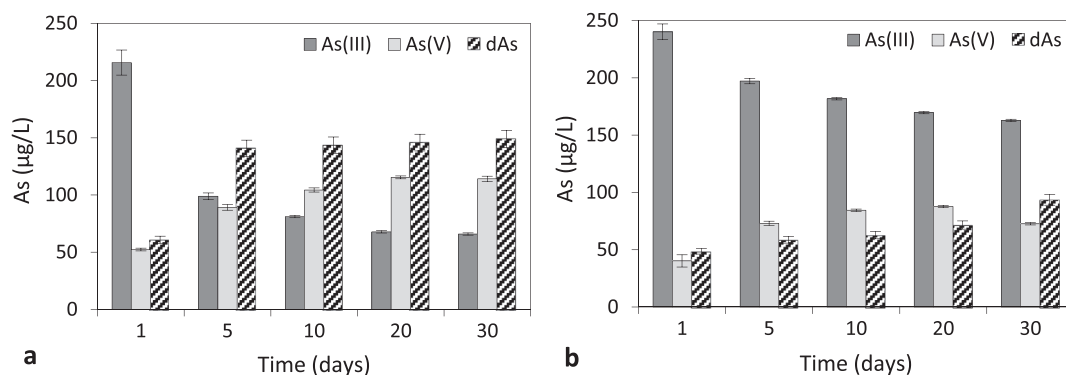

**Fig. 4.** Arsenic species (As(III), As(V), and removed As) and their average concentration in the duplicate (a) oxic and (b) anoxic storage systems. The error bar represents the standard deviation.

L of total As, with  $290(\pm 0.02)$   $\mu\text{g/L}$  being As(III). On the first day of operation, the oxic storage system contained  $267$   $\mu\text{g/L}$  of total As, in which As(III) was  $216$   $\mu\text{g/L}$  (Fig. 4a); the anoxic system contained  $280$   $\mu\text{g/L}$  of total As and  $240$   $\mu\text{g/L}$  of As(III) (Fig. 4b). After 5–10 days, the operational mode was considered to be stable (see the previous section), also reflected in the stabilization in As(III) concentrations after 10 days, with an average As(III) concentration of  $72(\pm 7)$   $\mu\text{g/L}$  and  $171$  ( $\pm 8$ )  $\mu\text{g/L}$  in the oxic and anoxic storage respectively (Fig. 4).


The elevated average As(V) concentration of  $95$   $\mu\text{g/L}$  (min.  $52$   $\mu\text{g/L}$  to the max.  $115$   $\mu\text{g/L}$ ) in the oxic storage indicates the high level of As(III) oxidation under aerated conditions, which may be due to various oxidation processes, such as enhanced homogeneous oxidation (Bissen and Frimmel, 2003; Shumlas et al., 2016), biological  $\text{As}^{3+}$  oxidation (Quéméneur et al., 2008; Cavalca et al., 2013), oxidation by reactive intermediates (OH,  $\text{H}_2\text{O}_2$  and  $\text{O}_2$ ) formed during  $\text{Fe}^{2+}$  oxidation and/or Fenton-like (Fe(IV) based) reactions (Hug et al., 2001; Hug and Leupin, 2003; Roberts et al., 2004; Sahai et al., 2007; Ciardelli et al., 2008). The higher As removal in the oxic storage, compared to the anoxic storage, is likely to be a consequence of produced HFO flocs that bind both As(III) and As(V). The findings are in agreement with studies by Holm (2002), and Mercer and Tobiason (2008), who found that higher in-situ HFO flocs formation in the oxic storage during aeration resulted in higher As removal. After the first 5 days, the As removal in the oxic storage was nearly constant at  $145(\pm 2)$   $\mu\text{g/L}$ , probably because an equilibrium was established between suspended and settled HFO flocs, while the latter did not further contribute to As removal. Over the experimental 30 days, it was observed that both  $\text{Fe}^{2+}$  and As(III) oxidation increased slightly, which could be induced by microbial activities (Shafiquzzaman et al., 2008; van Beek et al., 2012, 2015; Gude et al., 2018b).

In the case of the anoxic storage system, the low DO level ( $< 0.25$  mg/L) limited homogeneous As(III) oxidation (Bissen and


Frimmel, 2003; Shumlas et al., 2016), rapid  $\text{Fe}^{2+}$  oxidation and formation of abundant reactive intermediates (e.g., OH,  $\text{H}_2\text{O}_2$ , and  $\text{O}_2$ ), thus hampering As(V) formation. However, the observed As(III) concentration seemed to be slightly dropping over 30 days, likely due to the increase in  $\text{Fe}^{2+}$  oxidation over time (Fig. 4b). When calculating the ratio between oxidized  $\text{Fe}^{3+}$  and removed As on day 30, the amount of removed As per gram of Fe was higher in the system with anoxic storage ( $80(\pm 4)$   $\mu\text{gAs/mgFe}^{3+}$ ) than in the conventional oxic storage ( $60(\pm 5)$   $\mu\text{gAs/mgFe}^{3+}$ ), with a p-value of less than 0.05. The lower removal ratio in the oxic storage was in agreement with previous findings, where it has been stated that at pH above 7.0, As(V) removal with HFO flocs decreased considerably, due to lowering the positive surface charge, compared to systems with low pH (Wilkie and Hering, 1996; Katsoyannis and Zouboulis, 2002; Dixit and Hering, 2003; Senn et al., 2018). Other studies also revealed that freshly formed HFO flocs in anoxic systems are more efficient for As removal as opposed to pre-formed HFO flocs in the traditional oxic storage systems (Kim and Nriagu, 2000; Senn et al., 2018).

### 3.3. Fe and As oxidation-removal after aeration

Over the experimental period of 30 days, after both the oxic and the anoxic storage, the groundwater was aerated by dipping from 35 cm above the filter bed. The dissolved  $\text{Fe}^{2+}$ ,  $\text{Fe}^{3+}$ , As(III), and As(V) concentrations before and after aeration is shown in Fig. 5. After aeration before feeding the filtration units, the pH, DO and ORP for the oxic storage system was  $7.7(\pm 0.07)$ ,  $6.7(\pm 0.1)$  mg/L, and  $61(\pm 0.6)$  mV respectively and for the anoxic storage system, the pH, DO, and ORP was  $7.4(\pm 0.04)$ ,  $5.83(\pm 0.02)$  mg/L, and  $45.7(\pm 0.6)$  mV, correspondingly. The oxic storage water contained  $2.08(\pm 0.07)$  mg/L of total Fe, wherein 89% was HFO flocs ( $> 0.45$   $\mu\text{m}$ ), indicating no/limited  $\text{Fe}^{2+}$  was

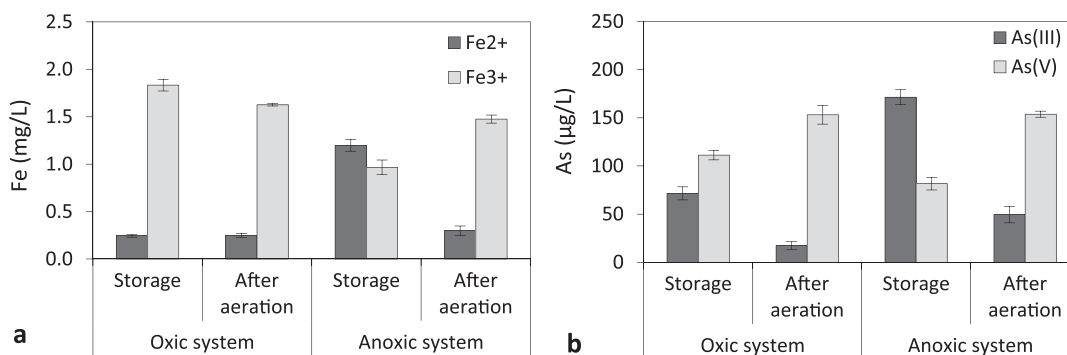

**Fig. 5.** The (a)  $\text{Fe}^{2+}$  and  $\text{Fe}^{3+}$ ; and (b) As(III) and As(V) species (average) concentration in the oxic and anoxic storage system and after aeration before the filter bed. The error bar represents the standard deviation of duplicate column experiments.

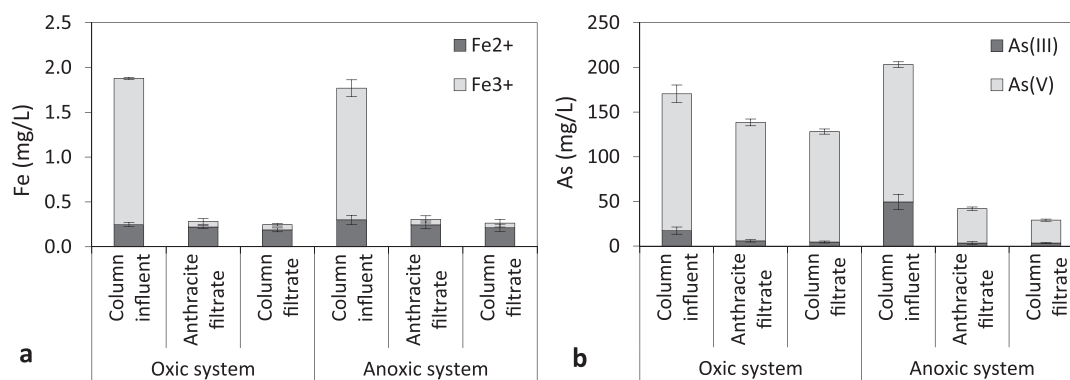

**Fig. 6.** The column influent, anthracite filtrate, and column filtrate (a) Fe<sup>2+</sup> and Fe<sup>3+</sup>; and (b) A(III) and As(V) species (average) concentration for the system with oxic and anoxic storage. The error bar represents the standard deviation of duplicate column experiments.

available for oxidation during the aeration before column feeding.

In the anoxic system, however, the introduction of O<sub>2</sub> during aeration before column feeding resulted in oxidation of the 1.20 mg/L of residual Fe<sup>2+</sup> from anoxic storage (Fig. 5a). Subsequently, Fe<sup>3+</sup> hydrolyzed to filterable/insoluble (0.45 μm membrane filter) Fe<sup>3+</sup> (HFO) flocs. Along with Fe<sup>2+</sup> oxidation, 120 μg/L of additional As(III) oxidation was also observed after this aeration step (Fig. 5b). In the oxic system, 55 μg/L of As(III) was also oxidized during the second aeration step, while Fe<sup>2+</sup> was not present anymore, probably as a result of homogeneous As(III) oxidation by DO or bacterial processes that could be developed over time (Shumlas et al., 2016; Gude et al., 2018b). During filtration, a supernatant water level of 15–20 cm was maintained to provide a hydraulic head and a saturated filter bed. The water sample was collected from the supernatant water, which was in contact with the top layer of the filter bed, providing a potential carrier for bacteria and promoting biological oxidation of As(III), as earlier reported by Katsoyiannis and Zouboulis (2004) and Gude et al. (2018b). The aeration step prior to filtration, thus aided in partial As(III) oxidation and As removal in both oxic and anoxic systems. However, the system with anoxic storage showed a higher As removal than the oxic storage system (p < 0.05), probably due to the presence of newly, in-situ formed active HFO flocs (Wilson et al., 2004; Mercer and Tobiason, 2008; Senn et al., 2018). The removed As after aeration (supernatant) of the oxic and the anoxic system was 12 μg/L (7%) and 50 μg/L (25%), respectively. This also confirmed the findings of the work of Roberts et al. (2004), who stated that multiple additions of Fe<sup>2+</sup> lead to more As(III) oxidation and removal compared to a higher and single Fe<sup>2+</sup> dose.

### 3.4. Fe and As removal in the filter bed

The dissolved Fe, As(III), and As(V) concentrations in the filtrate is shown in Fig. 6. For both the systems with oxic and anoxic storage, Fe removal was quick and efficient to result in 97% removal in the top anthracite layer. Independent of the storage systems before aeration-filtration, the filtrate Fe concentration was consistently lower than 0.3 mg/L (Fig. 6a), and thus below the WHO drinking water standard. Although the column influent concentrations of Fe<sup>2+</sup>/Fe<sup>3+</sup> and As(III)/As(V) were similar for both systems, As removal was considerably more effective in the columns that followed anoxic storage. The filtrate As concentration in the anoxic system was 28 μg/L, whereas in the oxic system it was 128 μg/L (p < 0.05) (Fig. 6b). Hering et al. (1996), proposed that the varied As removal with in-situ and pre-formed HFO flocs results from their surface charge differences. According to model predictions by Holm (2002), the removal capacity of As by in-situ HFO flocs can be 3.8 times higher than that of preformed HFO flocs. Other studies also indicate that the increase in surface site density of in-situ formed HFO flocs (0.7 mol site/molFe) is higher than the pre-formed HFO flocs


(0.205 mol site/molFe) (Fuller et al., 1993; Mercer and Tobiason, 2008). Furthermore, the lower filtrate pH of 7.1 in the anoxic system compared to the oxic system pH of 7.7 could be another reason for more As removal with adsorptive HFO flocs. The lower pH in the anoxic system slowed the HFO flocs formation (Katsoyiannis et al., 2008a; Gude et al., 2016; Zhang et al., 2019), and probably helped to increase the positive surface charge of HFO flocs, and thereby improved As removal (Willkie and Hering, 1996). According to Mercer and Tobiason (2008), for 90% As removal in an ideal scenario, the required Fe:As ratio is about 9 and 6 at pH 7.3 and 6.2 respectively, where Holm's (2002) study mentioned that the pH difference by two units can increase or decrease As removal from 10% to 90%.

Apart from HFO floc filtration, the filter bed probably also functioned as a bio-filter for As(III) oxidation by AsOB (Shafiquzzaman et al., 2008; Gude et al., 2018b). In both storage systems, the residual As(III) that enters the filter bed was fully oxidized to As(V) in the anthracite layer perhaps by the presence of AsOB in the filter bed (Gude et al., 2018b). They also indicated that the penetration of freshly or in-situ formed HFO flocs into the filter bed for the anoxic system facilitates more As(V) adsorption compared to pre-formed HFO flocs penetration for the oxic system (Wang et al., 2008; Amstaetter et al., 2010; Hohmann et al., 2010). Similar to Gude et al. (2016), the rapid removal of HFO flocs in the first layer resulted in the low As removal in the bottom sand layer (3–7 μg/L).


### 3.5. Ammonium, nitrate, and phosphate removal

Over the experimental period of 30-day, the concentrations of NH<sub>4</sub><sup>+</sup> and NO<sub>3</sub><sup>-</sup> in different treatment steps of the system with oxic and anoxic storage are shown in Fig. 7. In groundwater, the NH<sub>4</sub><sup>+</sup> and NO<sub>3</sub><sup>-</sup> concentrations were, on average, 0.96(±0.02) mg/L and 0.39(±0.02) mg/L, respectively (Table 1). After the first five days, the concentration of NH<sub>4</sub><sup>+</sup> decreased in the oxic system due to the onset of biological nitrification, resulting in NO<sub>3</sub><sup>-</sup> concentration increase by aerobic oxidation of NH<sub>4</sub><sup>+</sup> (Koch et al., 2019). The lack of DO in the anoxic storage system limited the NH<sub>4</sub><sup>+</sup> oxidation process, consequently, 0.79(±0.05) mg/L of NH<sub>4</sub><sup>+</sup> remained in the storage system. After 5–10 days, the oxidation of NH<sub>4</sub><sup>+</sup> was observed to commence in the filter bed for both the oxic and anoxic systems, as can be observed from the lowering of NH<sub>4</sub><sup>+</sup> and increase in NO<sub>3</sub><sup>-</sup> concentration in the filter bed (anthracite) (de Vet et al., 2011; van Kessel et al., 2015; Koch et al., 2019). However, the results did not imply a 1:1 NH<sub>4</sub><sup>+</sup> conversion to NO<sub>3</sub><sup>-</sup> (N-Balance), probably meaning that the nitrification process was not complete, resulting in (intermediate) nitrite (NO<sub>2</sub><sup>-</sup>) production. However, it may be concluded that the nitrification process, although delayed in start-up, was not hampered by the step-wise Fe<sup>2+</sup> oxidation sequence in the anoxic system.

The PO<sub>4</sub><sup>3-</sup> concentrations in the stored water and different treatment

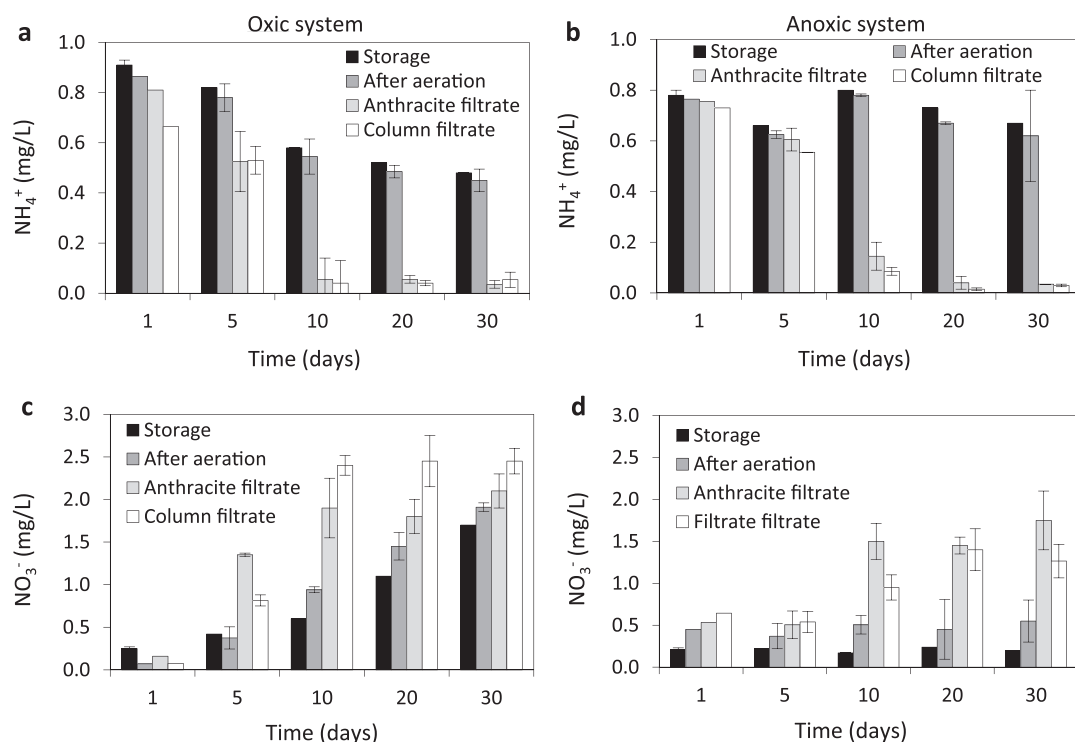

**Fig. 7.** The average concentration of (a-b)  $\text{NH}_4^+$  and (c-d)  $\text{NO}_3^-$  at different treatment steps of the system with oxidic (a, c) and anoxic (b, d) storage respectively. The error bar represents the standard deviation of duplicate dual-media sand filtration column experiments.

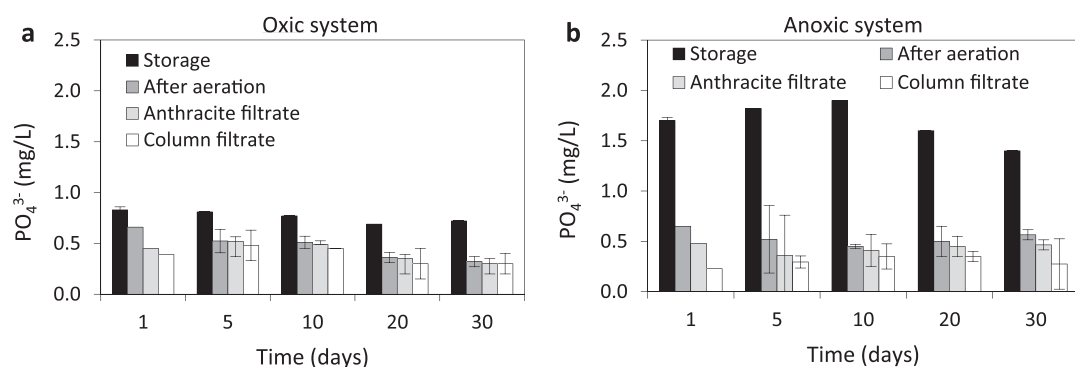

**Fig. 8.** The average  $\text{PO}_4^{3-}$  concentration at different treatment steps based on (a) oxidic and (b) anoxic storage system. The error bar represents the standard deviation of duplicate column experiments.

steps over time are depicted in Fig. 8. In the groundwater, the  $\text{PO}_4^{3-}$  concentration was  $2.15(\pm 0.03)$  mg/L, which dropped to an average of  $0.76(\pm 0.05)$  mg/L in the oxidic storage system (Fig. 8a). However, in the anoxic storage system,  $\text{PO}_4^{3-}$  concentration remained high at  $1.68(\pm 0.22)$  mg/L (Fig. 8b). The large decrease of  $\text{PO}_4^{3-}$  concentration in the oxidic storage system, compared to the anoxic storage system ( $p < 0.05$ ), can be explained by co-precipitation with HFO flocs (Guan et al., 2009; Voegelin et al., 2010) originating from rapid  $\text{Fe}^{2+}$  oxidation. In the anoxic storage followed by aeration-filtration, the  $\text{PO}_4^{3-}$  removal follows the step-wise  $\text{Fe}^{2+}$  oxidation.  $\text{PO}_4^{3-}$  was partially removed during anoxic storage ( $0.47 \pm 0.18$  mg/L) and aeration ( $1.14 \pm 0.06$  mg/L) before filtration (Fig. 8b). The removal of  $\text{PO}_4^{3-}$  was also observed at different layers of the filter bed (aerated water vs. anthracite filtrate vs. column filtrate), indicating ongoing adsorption of  $\text{PO}_4^{3-}$  onto HFO flocs. The concentration of  $\text{PO}_4^{3-}$  further decreased in the column filtrate to  $0.38(\pm 0.07)$  mg/L and  $0.30(\pm 0.05)$  mg/L from anthracite filtrate concentration of  $0.45(\pm 0.06)$  mg/L and  $0.43(\pm 0.04)$  mg/L respectively for the

oxic and anoxic systems.

#### 4. Considerations for application

The suitability of the As co-precipitation with naturally present  $\text{Fe}^{2+}$  by anoxic storage followed by aeration-sand filtration system was evaluated in Bangladesh based on the five criteria proposed by WHO (2013), which are effectiveness, appropriateness, acceptability, cost, and implementations.

In Bangladesh, people prefer using tubewells to other drinking water options due to low operation and maintenance costs, and water accessibility around the year (Hossain et al., 2014). With the proposed treatment method, it is possible to achieve As removal without using any additional chemicals. Moreover, it uses only locally available materials and works with an existing groundwater source. Previous studies suggested Fe/As ratios over 40 (mg/mg) would be required to reduce As levels below  $50 \mu\text{g/L}$  (Meng et al., 2002; Ware, 2013) with passive



treatment. The present study indicates that delayed aeration-oxidation of  $\text{Fe}^{2+}$  could be a promising method for As removal with Fe/As ratios as low as 10 (mg/mg). However, from a waste management perspective, it is recommended to apply this treatment scheme on a larger scale. Although the combination of anoxic storage with aeration-filtration requires a low As/Fe ratio, still As-containing sludge is being produced which needs to be disposed of. At the concentrations found during this study, As-containing Fe sludge can be used in brick industries or concrete masonry work (Rouf and Hossain, 2003). Prior to the application of this novel technology, it is recommended to further investigate the influence of groundwater matrices and varying operational parameters, which might impact As removal efficiency.

## 5. Conclusion

This study aimed to investigate the influence on As removal efficiency by delayed aeration using an anoxic pre-storage system followed by aeration and dual-media sand filtration. This novel treatment sequence was compared against conventional aeration-filtration for groundwater containing total As of 329  $\mu\text{g/L}$ , with 290  $\mu\text{g/L}$  being As (III) and 2.33  $\text{mgFe}^{2+}/\text{L}$ . The obtained step-wise  $\text{Fe}^{2+}$  oxidation with anoxic pre-storage enhanced As removal to 92%, compared to only 61% in the conventional oxic system. It is suggested that this was due to the formation of fresh HFO flocs during step-wise oxidation in the anoxic system that removed more As than the pre-formed HFO flocs in the oxic system. Moreover,  $\text{Fe}^{2+}$  oxidation did not compromise the removal of other groundwater contaminants like  $\text{NH}_4^+$  and  $\text{PO}_4^{3-}$ . Therefore, this study demonstrated that with anoxic storage, passive treatment is an effective barrier against As(III) with Fe/As ratios much lower (<10 mg/mg) than previously determined (>40 mg/mg). Consequently, the combination of anoxic storage followed by aeration and sand filtration can be used as a cost-effective and chemical-free alternative for removing As(III) from groundwater under field-relevant conditions.

## CRedit authorship contribution statement

**Md Annaduzzaman:** Conceptualization; Methodology; Investigation; Data curation; Analysis; Data visualization; Validation; Software; Writing- Original Draft Preparation, **Luuk C. Rietveld:** Supervision; Writing- Reviewing and Editing, **Bilqis Amin Hoque:** Supervision; Writing- Reviewing and Editing, **Md Niamul Bari:** Writing-Reviewing and editing; Experiments- Fieldwork supervision and organization, **Doris van Halem:** Supervision; Project leader; Experiments- Conceptualization and guidance on design; Data visualization; Writing-Reviewing and Editing.

## Declaration of Competing Interest

The authors declare that they have no known competing financial interests or personal relationships that could have appeared to influence the work reported in this paper.

## Acknowledgments

This study was supported by the DELTAP project funded by the NWO-WOTRO research grant. The authors acknowledge all research assistants from RUET, Rajshahi University, and EPRC in the pilot-scale experimentation in Rajshahi Bangladesh for their help and logistic supports during the intensive fieldwork. The authors also wish to thank landowner Md Sirajul Islam and his family, for allowing work to be done on their premises for the whole day over the entire experimental period. Without their support, this study would not have been possible.

## References

- Amen, R., Bashir, H., Bibi, I., Shaheen, S.M., Niazi, N.K., Shahid, M., Hussain, M.M., Antoniadis, V., Shakoor, M.B., Al-Solaimani, S.G., Wang, H., Bundschuh, J., Rinklebe, J., 2020. A critical review on arsenic removal from water using biochar-based sorbents: the significance of modification and redox reactions. *Chem. Eng. J.* 396, 125195 <https://doi.org/10.1016/j.cej.2020.125195>.
- Amstaetter, K., Borch, T., Larese-Casanova, P., Kappler, A., 2010. Redox transformation of arsenic by Fe(II)-activated goethite ( $\alpha\text{-FeOOH}$ ). *Environ. Sci. Technol.* 44, 102–108. <https://doi.org/10.1021/es901274s>.
- Annaduzzaman, M., Bhattacharya, P., Biswas, A., Hossain, M., Ahmed, K.M., van Halem, D., 2018. Arsenic and manganese in shallow tubewells: validation of platform color as a screening tool in Bangladesh. *Groundw. Sustain. Dev.* 6, 181–188. <https://doi.org/10.1016/j.gsd.2017.11.008>.
- Bissen, M., Frimmel, F.H., 2003. Arsenic - A review. Part II: oxidation of arsenic and its removal in water treatment. *Acta Hydrochim. Hydrobiol.* 31, 97–107. <https://doi.org/10.1002/ahch.200300485>.
- Biswas, A., Nath, B., Bhattacharya, P., Halder, D., Kundu, A.K., Mandal, U., Mukherjee, A., Chatterjee, D., Jacks, G., 2012. Testing tubewell platform color as a rapid screening tool for arsenic and manganese in drinking water wells. *Environ. Sci. Technol.* 46, 434–440. <https://doi.org/10.1021/es203058a>.
- Bruins, J.H., Vries, D., Petrussevi, B., Slokar, Y.M., Kennedy, M.D., 2014. Assessment of manganese removal from over 100 groundwater treatment plants. *J. Water Supply Res. Technol.* 63, 268–280. <https://doi.org/10.2166/aqua.2013.086>.
- Cavalca, L., Corsini, A., Andreoni, V., Muiyzer, G., 2013. Draft genome sequence of the arsenite-oxidizing strain Aliihoelea sp. ZWW, isolated from arsenic-contaminated groundwater. *Genome Announc.* 1, 2164. <https://doi.org/10.1128/genomeA.01072-13>.
- Cavalca, L., Zecchin, S., Zaccheo, P., Abbas, B., Rotiroli, M., Bonomi, T., Muiyzer, G., 2019. Exploring biodiversity and arsenic metabolism of microbiota inhabiting arsenic-rich groundwaters in Northern Italy. *Front. Microbiol.* 10, 1–15. <https://doi.org/10.3389/fmicb.2019.01480>.
- Chakraborti, D., Rahman, M.M., Das, B., Nayak, B., Pal, A., Sengupta, M.K., Hossain, M. A., Ahamed, S., Sahu, M., Saha, K.C., Mukherjee, S.C., Pati, S., Dutta, R.N., Qamruzzaman, Q., 2013. Groundwater arsenic contamination in Ganga-Meghna-Brahmaputra plain, its health effects and an approach for mitigation. *Environ. Earth Sci.* 70, 1993–2008. <https://doi.org/10.1007/s12665-013-2699-y>.
- Ciardelli, M.C., Xu, H., Sahai, N., 2008. Role of Fe(II), phosphate, silicate, sulfate, and carbonate in arsenic uptake by coprecipitation in synthetic and natural groundwater. *Water Res.* 42, 615–624. <https://doi.org/10.1016/j.watres.2007.08.011>.
- Cullen, W.R., Reimer, K.J., 1989. Arsenic speciation in the environment. *Chem. Rev.* 89, 713–764. <https://doi.org/10.1021/cr00094a002>.
- de Vet, W.W.J.M., Dinkla, I.J.T., Rietveld, L.C., van Loosdrecht, M.C.M., 2011. Biological iron oxidation by *Gallionella* spp. in drinking water production under fully aerated conditions. *Water Res.* 45, 5389–5398. <https://doi.org/10.1016/j.watres.2011.07.028>.
- Delaire, C., Amrose, S., Zhang, M., Hake, J., Gadgil, A., 2017. How do operating conditions affect As(III) removal by iron electrocoagulation? *Water Res.* <https://doi.org/10.1016/j.watres.2017.01.030>.
- Dixit, S., Hering, J.G., 2003. Comparison of arsenic(V) and arsenic(III) sorption onto iron oxide minerals: implications for arsenic mobility. *Environ. Sci. Technol.* 37, 4182–4189. <https://doi.org/10.1021/es030309t>.
- Fuller, C.C., Davis, J.A., Waychunas, G.A., 1993. Surface chemistry of ferrihydrite: part 2. Kinetics of arsenate adsorption and coprecipitation. *Geochim. Cosmochim. Acta* 57, 2271–2282.
- Guan, X., Dong, H., Ma, J., Jiang, L., 2009. Removal of arsenic from water: effects of competing anions on As(III) removal in  $\text{KMnO}_4\text{-Fe(II)}$  process. *Water Res.* 43, 3891–3899. <https://doi.org/10.1016/j.watres.2009.06.008>.
- Gude, J.C.J., Rietveld, L.C., van Halem, D., 2018a. As(III) removal in rapid filters: effect of pH, Fe(II)/Fe(III), filtration velocity and media size. *Water Res.* 147, 342–349. <https://doi.org/10.1016/j.watres.2018.10.005>.
- Gude, J.C.J., Rietveld, L.C., van Halem, D., 2018b. Biological As(III) oxidation in rapid sand filters. *J. Water Process Eng.* 21, 107–115. <https://doi.org/10.1016/j.jwpe.2017.12.003>.
- Gude, J.C.J., Rietveld, L.C., van Halem, D., 2016. Fate of low arsenic concentrations during full-scale aeration and rapid filtration. *Water Res.* 88, 566–574. <https://doi.org/10.1016/j.watres.2015.10.034>.
- Guo, H., Ren, Y., Liu, Q., Zhao, K., Li, Y., 2013. Enhancement of arsenic adsorption during mineral transformation from siderite to goethite: mechanism and application. *Environ. Sci. Technol.* 47, 1009–1016. <https://doi.org/10.1021/es303503m>.
- Han, X., Song, J., Li, Y.L., Jia, S.Y., Wang, W.-H., Huang, F.-G., Wu, S.-H., 2016. As(III) removal and speciation of Fe (Oxyhydr)oxides during simultaneous oxidation of As (III) and Fe(II). *Chemosphere* 147, 337–344. <https://doi.org/10.1016/j.chemosphere.2015.12.128>.
- Haque, E., Mailloux, B.J., de Wolff, D., Gilioli, S., Kelly, C., Ahmed, E., Small, C., Ahmed, K.M., van Geen, A., Bostick, B.C., 2018. Quantitative drinking water arsenic concentrations in field environments using mobile phone photometry of field kits. *Sci. Total Environ.* 618, 579–585. <https://doi.org/10.1016/j.scitotenv.2016.12.123>.
- Hering, J.G., Chen, P.-Y., Wilkie, J.A., Elimelech, M., Liang, S., 1996. Arsenic removal by ferric chloride. *Am. Water Works Assoc.* 88, 155–167. <https://doi.org/10.1002/j.1551-8833.1996.tb06541.x>.
- Hering, J.G., Katsoyiannis, I.A., Theoduloz, G.A., Berg, M., Hug, S.J., 2017. Arsenic removal from drinking water: experiences with technologies and constraints in practice. *J. Environ. Eng.* 143, 03117002 [https://doi.org/10.1061/\(ASCE\)EE.1943-7870.0001225](https://doi.org/10.1061/(ASCE)EE.1943-7870.0001225).

- Hohmann, C., Winkler, E., Morin, G., Kappler, A., 2010. Anaerobic Fe(II)-oxidizing bacteria show as resistance and immobilize as during Fe(III) mineral precipitation. *Environ. Sci. Technol.* 44, 94–101. <https://doi.org/10.1021/es900708s>.
- Holm, T.R., 2002. Effects of CO<sub>3</sub><sup>2-</sup>/bicarbonate, Si, and PO<sub>4</sub><sup>3-</sup> on arsenic sorption to HFO. *Am. Water Works Assoc.* 94, 174–181. <https://doi.org/10.1002/j.1551-8833.2002.tb09461.x>.
- Holm, T.R., Wilson, S.D., 2006. *Chemical Oxidation for Arsenic Removal*. Midwest Technology Assistance Center. Illinois State Water Survey.
- Hoque, B.A., Hoque, M.M., Ahmed, T., Islam, S., Azad, A.K., Ali, N., Hossain, M., Hossain, M.S., 2004. Demand-based water options for arsenic mitigation: an experience from rural Bangladesh. *Public Health* 118, 70–77. [https://doi.org/10.1016/S0033-3506\(03\)00135-5](https://doi.org/10.1016/S0033-3506(03)00135-5).
- Hoque, B.A., Yamaura, S., Sakai, A., Khanam, S., Karim, M., Hoque, Y., Hossain, S., Islam, S., Hossain, O., 2006. Arsenic mitigation for water supply in Bangladesh: appropriate technological and policy perspectives. *Water Qual. Res. J. Can.* 41, 226–234.
- Hossain, M., Bhattacharya, P., Frappe, S.K., Jacks, G., Islam, M.M., Rahman, M.M., von Brömssen, M., Hasan, M.A., Ahmed, K.M., 2014. Sediment color tool for targeting arsenic-safe aquifers for the installation of shallow drinking water tubewells. *Sci. Total Environ.* 493, 615–625. <https://doi.org/10.1016/j.scitotenv.2014.05.064>.
- Hossain, M., Rahman, S.N., Bhattacharya, P., Jacks, G., Saha, R., Rahman, M., 2015. Sustainability of arsenic mitigation interventions — an evaluation of different alternative safe drinking water options provided in Matlab, an arsenic hot spot in Bangladesh. *Front. Environ. Sci.* 3, 1–15. <https://doi.org/10.3389/fenvs.2015.00030>.
- Hug, S.J., Canonica, L., Wegelin, M., Gechter, D., von Gunten, U., 2001. Solar oxidation and removal of arsenic at circumneutral pH in iron containing waters. *Environ. Sci. Technol.* 35, 2114–2121. <https://doi.org/10.1021/es01551s>.
- Hug, S.J., Leupin, O., 2003. Iron-catalyzed oxidation of arsenic(III) by oxygen and by hydrogen peroxide: pH-dependent formation of oxidants in the Fenton reaction. *Environ. Sci. Technol.* 37, 2734–2742. <https://doi.org/10.1021/es026208x>.
- Karori, S., Clifford, D., Ghurye, G., Samanta, G., 2006. Development of a field speciation method. *Am. Water Works Assoc.* 98, 128–141. <https://doi.org/10.1002/j.1551-8833.2006.tb07666.x>.
- Katsiyannis, I.A., Ruettimann, T., Hug, S.J., 2008a. pH dependence of fenton reagent generation and As(III) oxidation and removal by corrosion of zero valent iron in aerated water. *Environ. Sci. Technol.* 43, 7424–7430. <https://doi.org/10.1021/es802563j>.
- Katsiyannis, I.A., Voegelin, A., Zouboulis, A.I., Hug, S.J., 2015. Enhanced As(III) oxidation and removal by combined use of zero valent iron and hydrogen peroxide in aerated waters at neutral pH values. *J. Hazard. Mater.* 297, 1–7. <https://doi.org/10.1016/j.jhazmat.2015.04.038>.
- Katsiyannis, I.A., Zikoudi, A., Hug, S.J., 2008b. Arsenic removal from groundwaters containing iron, ammonium, manganese and phosphate: a case study from a treatment unit in northern Greece. *Desalination* 224, 330–339. <https://doi.org/10.1016/j.desal.2007.06.014>.
- Katsiyannis, I.A., Zouboulis, A.I., 2004. Biological treatment of Mn(II) and Fe(II) containing groundwater: kinetic considerations and product characterization. *Water Res.* 38, 1922–1932. <https://doi.org/10.1016/j.watres.2004.01.014>.
- Katsiyannis, I.A., Zouboulis, A.I., 2002. Removal of arsenic from contaminated water sources by sorption onto iron-oxide-coated polymeric materials. *Water Res.* 36, 5141–5155.
- Kim, M.J., Nriagu, J., 2000. Oxidation of arsenite in groundwater using ozone and oxygen. *Sci. Total Environ.* 247, 71–79. [https://doi.org/10.1016/S0048-9697\(99\)00470-2](https://doi.org/10.1016/S0048-9697(99)00470-2).
- Koch, H., van Kessel, M.A.H.J., Lückler, S., 2019. Complete nitrification: insights into the ecophysiology of comammox Nitrospira. *Appl. Microbiol. Biotechnol.* 103, 177–189.
- Lafferty, B.J., Ginder-Vogel, M., Zhu, M., Livi, K.J.T., Sparks, D.L., 2010. Arsenite oxidation by a poorly crystalline manganese-oxide. 2. Results from X-ray absorption spectroscopy and X-ray diffraction. *Environ. Sci. Technol.* 44, 8467–8472. <https://doi.org/10.1021/es102016c>.
- Li, L., van Genuchten, C.M., Addy, S.E.A., Yao, J., Gao, N., Gadgil, A.J., 2012. Modeling As(III) oxidation and removal with iron electrocoagulation in groundwater. *Environ. Sci. Technol.* 46, 12038–12045. <https://doi.org/10.1021/es302456b>.
- Lin, K., Lind, S., Boe-Hansen, R., Smets, B.F., Albrechtsen, H.-J., 2012. Biological removal of iron and manganese in rapid sand filters – Process understanding of iron and manganese removal Biological removal of manganese and iron in rapid sand filters, in: Paper Presented at AWWA Water Quality Technology Conference (WQTC), Toronto, Canada. General.
- Lowry, J.D., Lowry, S.B., 2002. Oxidation of As(III) by Aeration and Storage. United States Environment Protection Agency, EPA/600/R-01/102.
- Luzi, S., Berg, M., Thi Kim Trang, P., Hung Viet, P., Schertenleib EAWAG, R., Nam MOH, V., Samuel Luzi, A., Michael Berg, E., Pham Thi Kim Trang, E., Pham Hung Viet, H., Roland Schertenleib, H., Eggenberger, M., Mai Dung, D., Boeni, B., Meyer MARD, W., Dinh Ninh, N., Quang Tuan, L., Xuan Su MONRE, P., Dinh Phuc MOH, D., Huy Nga NHEGD, N., Van Dan, N., Ngoc Thanh, T., Thanh Hai CETASD, N., Hong Nhat, B., Thanh Binh, L., Thi Minh Hue, N., Trong Hai, N., Minh Khoi, P., Thi Mai Lan, V., Thi Hong Giang, D., Thu Huong EAWAG, T., Stengel, C., Bolotin, J., Giger, W., Hug, S., Peter, S., 2004. Household Sand Filters for Arsenic Removal An option to mitigate arsenic from iron-rich groundwater MONRE Ministry of Natural Resources and.
- Manning, B.A., Fendorf, S.E., Bostick, B., Suarez, D.L., 2002. Arsenic(III) oxidation and arsenic(V) adsorption reactions on synthetic birnessite. *Environ. Sci. Technol.* 36, 976–981. <https://doi.org/10.1021/es0110170>.
- Meng, X., Korfiatis, G.P., Bang, S., Bang, K.W., 2002. Combined effects of anions on arsenic removal by iron hydroxides. *Toxicol. Lett.* 133, 103–111. [https://doi.org/10.1016/S0378-4274\(02\)00080-2](https://doi.org/10.1016/S0378-4274(02)00080-2).
- Meng, X., Korfiatis, G.P., Christodoulatos, C., Bang, S., 2001. Treatment of arsenic in Bangladesh well water using a household co-precipitation and filtration system. *Water Res.* 35, 2805–2810. [https://doi.org/10.1016/S0043-1354\(01\)00007-0](https://doi.org/10.1016/S0043-1354(01)00007-0).
- Mercur, K.L., Tobiasson, J.E., 2008. Removal of arsenic from high ionic strength solutions: effects of ionic strength, pH, and preformed versus in situ formed HFO. *Environ. Sci. Technol.* 42, 3797–3802. <https://doi.org/10.1021/es702946s>.
- Morgan, B., Lahav, O., 2007. The effect of pH on the kinetics of spontaneous Fe(II) oxidation by O<sub>2</sub> in aqueous solution - basic principles and a simple heuristic description. *Chemosphere* 68, 2080–2084. <https://doi.org/10.1016/j.chemosphere.2007.02.015>.
- Morrison, S.J., Metzler, D.R., Dwyer, B.P., 2002. Removal of As, Mn, Mo, Se, U, V and Zn from groundwater by zero-valent iron in a passive treatment cell: reaction progress modeling. *J. Contam. Hydrol.* 56, 99–116.
- Niazi, N.K., Bibi, I., Shahid, M., Ok, Y.S., Burton, E.D., Wang, H., Shaheen, S.M., Rinklebe, J., Lüttge, A., 2018. Arsenic removal by perilla leaf biochar in aqueous solutions and groundwater: an integrated spectroscopic and microscopic examination. *Environ. Pollut.* 232, 31–41. <https://doi.org/10.1016/j.envpol.2017.09.051>.
- Nordstrom, D.K., 2002. Worldwide occurrences of arsenic in groundwater. *Science* 296, 2143–2145. <https://doi.org/10.1126/science.1072375>.
- Perez, M.E.C., Francisca, F.M., 2013. Digital analysis technique for uncertainty reduction in colorimetric arsenic detection method. *J. Environ. Sci. Health - Part A Toxicol. Hazard. Subst. Environ. Eng.* 48, 191–196. <https://doi.org/10.1080/10934529.2012.717811>.
- Pio, I., Scarlino, A., Bloise, E., Mele, G., Santoro, O., Pastore, T., Santoro, D., 2015. Efficient removal of low-arsenic concentrations from drinking water by combined coagulation and adsorption processes. *Sep. Purif. Technol.* 147, 284–291. <https://doi.org/10.1016/j.seppur.2015.05.002>.
- Quéméneur, M., Heinrich-Salmeron, A., Muller, D., Lièvremon, D., Jauzein, M., Bertin, P.N., Garrido, F., Joulian, C., 2008. Diversity surveys and evolutionary relationships of aoxB genes in aerobic arsenite-oxidizing bacteria. *Appl. Environ. Microbiol.* 74, 4567–4573. <https://doi.org/10.1128/AEM.02851-07>.
- Rahman, M.M., 2017. Field Experiments and Reactive Transport Modeling of Subsurface Arsenic Removal in Bangladesh. Delft University of Technology. <https://doi.org/10.4233/uaid:5b950e57-3704-43b2-ab03-f0da1dd79cc9>.
- Roberts, L.C., Hug, S.J., Ruettimann, T., Billah, M., Khan, A.W., Rahman, M.T., 2004. Arsenic removal with iron(II) and iron(III) in waters with high silicate and phosphate concentrations. *Environ. Sci. Technol.* 38, 307–315. <https://doi.org/10.1021/es0343205>.
- Rosso, J.J., Troncoso, J.J., Fernández Cirelli, A., 2011. Geographic distribution of arsenic and trace metals in lotic ecosystems of the Pampa Plain, Argentina. *Bull. Environ. Contam. Toxicol.* 86, 129–132. <https://doi.org/10.1007/s00128-010-0177-8>.
- Rouf, M.A., Hossain, M.D., 2003. Effects of Using Arsenic-Iron Sludge in Brick Making. *Fate of Arsenic in the Environment*, pp. 193–208.
- Sahai, N., Lee, Y.J., Xu, H., Ciardelli, M., Gaillard, J.-F., 2007. Role of Fe(II) and phosphate in arsenic uptake by coprecipitation. *Geochim. Cosmochim. Acta* 71, 3193–3210. <https://doi.org/10.1016/j.gca.2007.04.008>.
- Senn, A.C., Hug, S.J., Kaegi, R., Hering, J.G., Voegelin, A., 2018. Arsenate coprecipitation with Fe(II) oxidation products and retention or release during precipitate aging. *Water Res.* 131, 334–345. <https://doi.org/10.1016/j.watres.2017.12.038>.
- Shafiquzzaman, M., Mishima, I., Nakajima, J., 2008. Arsenic removal from ground water by sand filtration during biological iron oxidation. *Jpn. J. Water Treat. Biol.* 44, 11–20.
- Shakoor, M.B., Niazi, N.K., Bibi, I., Shahid, M., Saqib, Z.A., Nawaz, M.F., Shaheen, S.M., Wang, H., Tsang, D.C.W., Bundschuh, J., Ok, Y.S., Rinklebe, J., 2019. Exploring the arsenic removal potential of various biosorbents from water. *Environ. Int.* 123, 567–579. <https://doi.org/10.1016/j.envint.2018.12.049>.
- Sharma, A.K., Sorlini, S., Crotti, B.M., Collivignarelli, M.C., Tjell, J.C., Abbà, A., 2016. Enhancing arsenic removal from groundwater at household level with naturally occurring iron. *Ambient. Água - Interdiscip. J. Appl. Sci.* 11, 487–498. <https://doi.org/10.4136/ambi-agua.1815>.
- Shumlas, S.L., Singireddy, S., Thenuwar, A.C., Attanayake, N.H., Reeder, R.J., Strongin, D.R., 2016. Oxidation of arsenite to arsenate on birnessite in the presence of light. *Geochim. Trans.* 17, 1–10. <https://doi.org/10.1186/s12932-016-0037-5>.
- Smedley, P.L., Kinniburgh, D.G., 2002. A review of the source, behaviour and distribution of arsenic in natural waters. *Appl. Geochem.* 17, 517–568. [https://doi.org/10.1016/S0883-2927\(02\)00018-5](https://doi.org/10.1016/S0883-2927(02)00018-5).
- Smith, A.H., Lingas, E.O., Rahman, M., 2000. Contamination of drinking water by arsenic in Bangladesh: a public health emergency. *Bull. World Health Organ.* 78, 1093–1103. <https://doi.org/10.1590/S0042-9686200000900005>.
- Sorlini, S., Gialdini, F., 2014. Study on arsenic removal in the drinking water treatment plant of Cremona (Italy). *J. Water Supply Res. Technol. - AQUA* 63, 625–629. <https://doi.org/10.2166/aqua.2014.195>.
- Sorlini, S., Gialdini, F., 2010. Conventional oxidation treatments for the removal of arsenic with chlorine dioxide, hypochlorite, potassium permanganate and monochloramine. *Water Res.* 44, 5653–5659. <https://doi.org/10.1016/j.watres.2010.06.032>.
- Stumm, W., Lee, G.F., 1961. Oxygenation of ferrous iron. *Ind. Eng. Chem.* 53, 143–146. <https://doi.org/10.1021/ie50614a030>.
- Su, C., Puls, R.W., 2001. Arsenate and arsenite removal by zerovalent iron: effects of phosphate, silicate, carbonate, borate, sulfate, chromate, molybdate, and nitrate, relative to chloride. *Environ. Sci. Technol.* 35, 4562–4568. <https://doi.org/10.1021/1010768z>.

- Tian, Z., Feng, Y., Guan, Y., Shao, B., Zhang, Y., Wu, D., 2017. Opposite effects of dissolved oxygen on the removal of As(III) and As(V) by carbonate structural Fe(II). *Sci. Rep.* 7, 1–11. <https://doi.org/10.1038/s41598-017-17108-4>.
- Uddin, M.M., Kurisu, F., Kasuga, I., Furumai, H., Islam, S.M.A., 2019. Potential of biological arsenite oxidation in sand filtration units at arsenic-iron removal plants (AIRPs) in Bangladesh. *Appl. Water Sci.* 9, 1–7. <https://doi.org/10.1007/s13201-019-0932-x>.
- van Beek, C.G.E.M., Dusseldorp, J., Joris, K., Huysman, K., Leijssen, H., Schoonenberg Kegel, F., de Vet, W.W.J.M., van De Wetering, S., Hofs, B., 2015. Contributions of homogeneous, heterogeneous and biological iron(II) oxidation in aeration and rapid sand filtration (RSF) in field sites. *J. Water Supply Res. Technol. - AQUA* 65, 195–207. <https://doi.org/10.2166/aqua.2015.059>.
- van Beek, C.G.E.M., Hiemstra, T., Hofs, B., Nederlof, M.M., Van Paassen, J.A.M., Reijnen, G.K., 2012. Homogeneous, heterogeneous and biological oxidation of iron (II) in rapid sand filtration. *J. Water Supply Res. Technol. - AQUA* 61, 1–13. <https://doi.org/10.2166/aqua.2012.033>.
- van Kessel, M.A.H.J., Speth, D.R., Albertsen, M., Nielsen, P.H., den Camp, H.J.M.O., Kartal, B., Jetten, M.S.M., Lückner, S., 2015. Complete nitrification by a single microorganism. *Nature* 528, 555–559. <https://doi.org/10.1038/nature16459>.
- Villalobos, M., Escobar-Quiroz, I.N., Salazar-Camacho, C., 2014. The influence of particle size and structure on the sorption and oxidation behavior of birnessite: I. Adsorption of As(V) and oxidation of As(III). *Geochim. Cosmochim. Acta* 125, 564–581. <https://doi.org/10.1016/j.gca.2013.10.029>.
- Voegelin, A., Hug, S.J., 2003. Catalyzed oxidation of arsenic(III) by hydrogen peroxide on the surface of ferrihydrite: an in situ ATR-FTIR study. *Environ. Sci. Technol.* 37, 972–978. <https://doi.org/10.1021/es025845k>.
- Voegelin, A., Kaegi, R., Frommer, J., Vantelon, D., Hug, S.J., 2010. Effect of phosphate, silicate, and Ca on Fe(III)-precipitates formed in aerated Fe(II)- and As(III)-containing water studied by X-ray absorption spectroscopy. *Geochim. Cosmochim. Acta* 74, 164–186. <https://doi.org/10.1016/j.gca.2009.09.020>.
- Vries, D., Bertelkamp, C., Schoonenberg Kegel, F., Hofs, B., Dusseldorp, J., Bruins, J.H., de Vet, W., van den Akker, B., 2017. Iron and manganese removal: recent advances in modelling treatment efficiency by rapid sand filtration. *Water Res.* 109, 35–45. <https://doi.org/10.1016/j.watres.2016.11.032>.
- Wang, Y., Morin, G., Ona-Nguema, G., Menguy, N., Juillot, F., Aubry, E., Guyot, F., Calas, G., Brown Jr., G.E., 2008. Arsenite sorption at the magnetite-water interface during aqueous precipitation of magnetite: EXAFS evidence for a new arsenite surface complex. *Geochim. Cosmochim. Acta* 72, 2573–2586. <https://doi.org/10.1016/j.gca.2008.03.011>.
- Ware, B.H., 2013. *Impact of Interfering Compounds on the Ferric Chloride Arsenic Removal Treatment Process*. Washington State University.
- WHO, 2013. *Household water treatment and safe storage (HWTS): manual for the participant*, Routledge Handbook of Water and Health. Geneva, Switzerland. (<https://doi.org/10.4324/9781315693606>).
- Wilkie, J.A., Hering, J.G., 1996. Adsorption of arsenic onto hydrous ferric oxide: effects of adsorbate/adsorbent ratios and co-occurring solutes. *Colloids Surf.* 107, 97–110.
- Wilson, S.D., Kelly, W.R., Holm, T.R., Talbot, J.L., 2004. *Arsenic Removal in Water Treatment Facilities: Survey of Geochemical Factors and Pilot Plant Experiments*. Midwest Technology Assistance Center, Champaign, IL.
- Zhang, S., Niu, H., Cai, Y., Zhao, X., Shi, Y., 2010. Arsenite and arsenate adsorption on coprecipitated bimetal oxide magnetic nanomaterials: MnFe<sub>2</sub>O<sub>4</sub> and CoFe<sub>2</sub>O<sub>4</sub>. *Chem. Eng. J.* 158, 599–607. <https://doi.org/10.1016/j.cej.2010.02.013>.
- Zhang, W., Liu, C., Wang, L., Zheng, T., Ren, G., Li, J., Ma, J., Zhang, G., Song, H., Zhang, Z., Li, Z., 2019. A novel nanostructured Fe-Ti-Mn composite oxide for highly efficient arsenic removal: preparation and performance evaluation. *Colloids Surf. A* 561, 364–372. <https://doi.org/10.1016/j.colsurfa.2018.10.077>.